

Environmental Monitoring Report

10th Semi-Annual (July – December 2020) Report



ASHUGANJ 400 MW (EAST) COMBINED CYCLE POWER PLANT PROJECT

At Ashuganj, Brahmanbaria



Ashuganj Power Station Company Limited (APSCCL)

Rev	Date	Prepared By	Approved By	Description
00	December 2020	Md. Dilshad-Ibne-Baqui Assistant Manager (HS&E) Ashuganj 400 MW CCPP (East) Project, APSCL.	Md. Atiqur Rahman, Manager (HS&E), APSCL.	10 th Semi-Annual Environmental Monitoring Report

Contents

EXECUTIVE SUMMARY	5
1.0 INTRODUCTION.....	7
1.1 Location of the Project	7
1.2 Project Progress Status	8
2.0 Safeguard Compliance Performance of the Project.....	9
2.1 Compliance with the Environmental Provisions of National Legal Instruments.....	9
2.2 SPS, 2009 compliance status.....	11
2.3 Compliance of environmental covenants from the ADB loan agreement	12
2.0 ENVIRONMENTAL STATUS.....	16
3.1 Analytical Monitoring and Observations	16
3.1.1 Air Quality Monitoring	16
3.1.2 Noise Measurement.....	20
3.1.3 Water Quality Analysis	23
3.1.3.1 Drinking Water Quality Analysis.....	23
3.1.3.2 River Water Quality Analysis	28
3.1.3.3 Ground Water Quality Analysis	30
3.1.4 Soil Quality Analysis	33
3.2 Visual Monitoring and Observations	33
3.2.1 Traffic Volume.....	34
3.2.2 Site Security	34
3.2.3 Personal Protective Equipment	35
3.2.4 Incident Record & Reporting	36
3.2.5 Solid Waste	36
3.2.6 Worker’s Health and COVID Response	37
3.2.7 Grievance Redress mechanism.....	38
3.2.8 Safety orientation & training of workers.....	39
3.2.9 Sanitation & Drinking Water Facility	41
3.2.10 Site Drainage	41
3.2.11 Dust Control	42
3.2.12 Oily Waste Generation & Disposal System	42
4.0 CONCLUSION AND RECOMMENDATION.....	42
ANNEX-I: PHOTO APPENDIX.....	44
ANNEX-II: MONITORING LOCATIONS	46
ANNEX-III: LABORATORY TEST RESULT	48

List of Tables

Table 1: Project Progress Status	8
Table 2: National Legal Instruments Related to the Emergency Assistance Project.....	9
Table 3: ADB Safeguards Policy compliance Status for the Projects	11
Table 4: Compliance with Environmental Considerations of Loan Agreements	12
Table 5: Implementation of environmental monitoring plan during construction phase.....	16
Table 6: Test Result of Ambient Air Quality	18
Table 7: Test Result of Noise Quality	23

Table 8: Drinking Water Quality Test Result.....	25
Table 9: River Water Quality Test Result	28
Table 10: Ground Water Quality.....	31
Table 11: Soil Quality	33
Table 12: Implementation of environmental Monitoring Plan during Construction Phase of the Project (Visual)	33
Table 13: List of Personal Protective Equipment Used in Project Site	35
Table 14: Waste Inventory Log of CNTIC-CCOEC Consortium	37
Table 15: Members of the Committee of Grievance Redress (GRC).....	39
Table 16: Summary of HSE Management	40

List of Figures

Figure 1: Location Map of APSCL 400 MW CCPP (East) project.....	7
Figure 2: Construction Works.....	8
Figure 3: Latest Picture of the Project Site (Construction going on).....	9
Figure 4 Air quality monitoring	18
Figure 5: Noise level monitoring (Day time).....	21
Figure 6: Noise level monitoring (Night time)	22
Figure 7: Drinking Water Sampling	25
Figure 8: River Water Sampling	28
Figure 9: Ground water sampling	31
Figure 10: Site Security & Safety Instruction Board	35
Figure 11: Use of Proper PPEs	36
Figure 12: On-site Ambulance and furnished First Aid box.....	38
Figure 13: Daily Body Temperature Monitoring.....	38
Figure 14: On-site Hand Washing Facility & Supply of Hand Sanitizer, Soap & Mask	38
Figure 15: Toolbox meeting & training of workers.....	40
Figure 16: Pure Drinking Water & Sanitation facility to workers.....	41
Figure 17: Site drainage condition.....	42
Figure 18: Water spraying for dust control.....	42

EXECUTIVE SUMMARY

During the period from July to December 2020, the EPC Contractor has carried out mainly HRSG foundation works, Central Control Building (CCB), Main Building and Turbine Base, Gas booster and conditioning station, Exhaust Stack, Air compressor Building, Air Storage tank, Service and Firewater pump house, Service and Firewater tank, Emergency Oil pit, Oily wastewater treatment station, sewage treatment station etc. To complete those works, they mobilize the equipment's, workers and materials.

In this period there is no discharge and for this, there is no impact on the living things in the water body. Air Pollution caused by dust emission during construction traffic activities is controlled by good management practices like continuous water spray over the unpaved or bare surfaces, covering soil materials pile. Soil and water pollutions are also prevented by proper management like spill prevention and well drainage system. Solid waste is managed by the waste management plan. Noise pollution is also a regarding the issue during Steel Structure Erection activities for using of demolition equipment's and for traffic and transport. Noise level is reduced by using fine-tuned low noise level construction equipment's and by the proper traffic management system. Every personnel use personal protective equipment to ensure their safety. The remarkable achievement in this period is that till now there is no record of loss time accident or injury.

Besides this, visual monitoring included traffic volume, site security, personal protective equipment, incident record and reporting, solid and oily wastes generation and disposal, worker's health, complaints from neighbors, safety orientation and training of workers, sanitation and drinking water facilities to the worker's and site drainage is covered during this period and its found that all aspects regarding visual monitoring were found in line with the environmental management plan and required environmental guidelines.

APSCL is committed to keeping the accident level in Zero by implementing its proper occupational health and safety management system. This project also has a positive effect on the socio-economic condition. Local skilled and semi-skilled peoples are engaged in different levels of construction activities and they are happy about getting employment opportunities.

On March 8, Bangladesh confirmed three cases of novel coronavirus on its territory. After that, APSCL has been paying close attention to the latest situation of COVID-19 spreading in Bangladesh and we are currently raising awareness & taking preventive action as a continuous process on this matter. During this critical period, APSCL immediately took the necessary precautions to protect all of its staff against virus infection and has taken immediate action on EPC contractors to prevent the spread of Covid-19 from new project activities like under construction 400 MW CCPP (East) Project by controlling of movement of foreigners, local workers and other construction & maintenance activities of APSCL.

APSCL follows WHO & Govt. of Bangladesh guidelines to prevent COVID-19 situation. Besides this, APSCL has taken its own policy to protect its community from COVID-19 and it is also mandatory for EPC contractor of this project to follow APSCL's policy, WHO and Government of Bangladesh guidelines on this issue. EPC contractor is also following its own stringent COVID-19 policy to prevent this disease at the project site.

1.0 INTRODUCTION

The objective of the environmental safeguard management and monitoring is to record environmental impacts resulting from the project activities and to ensure implementation of the “mitigation measures” identified earlier in order to reduce adverse impacts and enhance positive impacts from specific project activities. Besides, it would also address any unexpected or unforeseen environmental impacts that may arise during construction and operation phases of the project. ADB environmental safeguards objectives are: (i) to ensure the environmental soundness and sustainability of projects and (ii) to support the integration of environmental considerations into the project decision-making process. ADB environmental safeguards are triggered if a project is likely to have potential environmental risks and impacts.

1.1 Location of the Project

The power plant is setting up at the existing power plant area of Ashuganj Power Station Company Ltd. (APSCCL) at Ashuganj, Brahmanbaria, Bangladesh. Ashuganj is located on the east bank of the Meghna River about 91 km Northeast to Dhaka & is connected by railway & highway way with Dhaka. There also exists good waterway connection to the site by seaports of Chittagong and Mongla. The project is located in Sonaram Mouza of Ashuganj Upazila, Brahmanbaria District. The location map of APSCCL 400 MW (East) is shown in Figure 1. Bangladesh UK Friendship Bridge across the river Meghna (Meghna Bridge) connects both the banks of Bhairab and Ashuganj which connects with Dhaka-Sylhet highway which passes at the south side of the project. Meghna River is in the north side of the project. A khal is situated in the east side of the project and the total APSCCL complex including APSCCL office is located on the west side of the project.

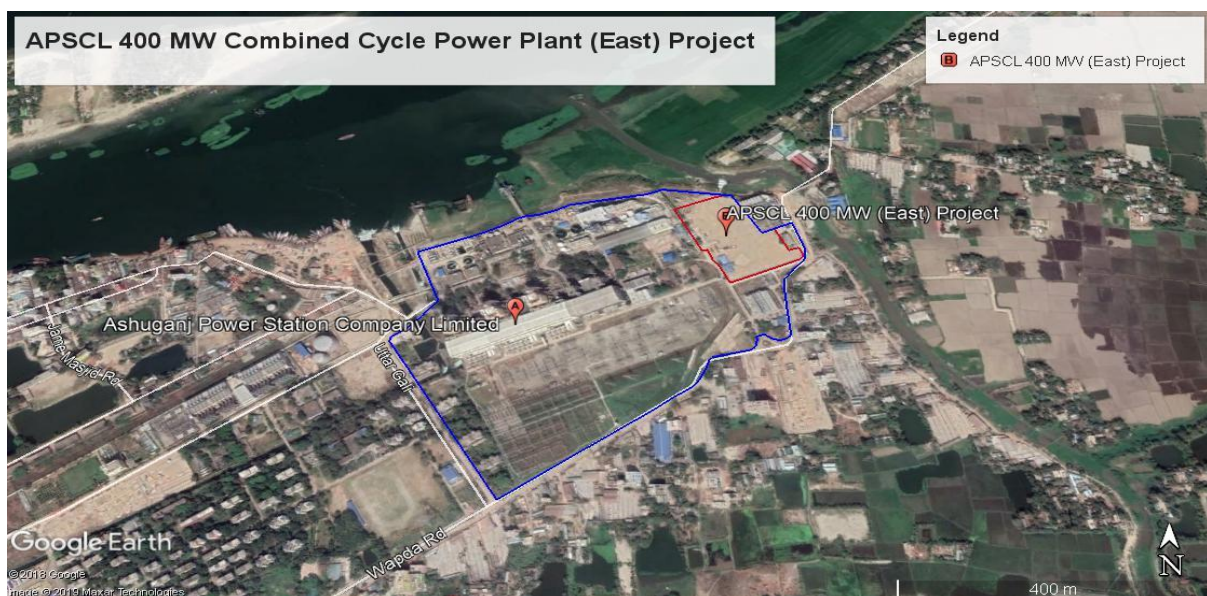


Figure 1: Location Map of APSCCL 400 MW CCPP (East) project

1.2 Project Progress Status

APSCL and CNTIC are working so hard to reach the target within the timeframe. About 66% of work has been done where 8% was done in this semi-annual. Majority of work was related to the erection of auxiliary system, structural work of main building, civil work of hydrogen generation station, installation of Main stack, civil work of Control building, equipment installation of gas station etc. The updated status of Ashuganj 400 MW (East) Combined Cycle Power Plant Project (CCPP) from July 2020 to 6th December 2020 is given below in Table 1 & **Figure 2, 3** shows the present site condition wherein construction work is going on. Foundation work of Bypass stack, Turbine, Generator, Demi water storage tank, fire & service water storage tank, unit transformer and auxiliary transformer and water intake point has been completed. Major mechanical work of casing of turbine hall, Air compressor building, central control Building (CCB), Heat Recovery Stream Generator (HRSG), Power control center, Exhaust stack super structure work, demi water storage tank, RMS is going on. Site processing is in progress for cooling water discharge, Pump house, Gas booster and transformer. Chemical treatment plant and Water intake plant construction work is going on. Site processing and foundation work is going on for Emergency Oil pit, Oily waste water treatment station, sewage treatment station & Gas booster and conditioning station.

Table 1: Project Progress Status

Sl No.	Task Name	Progress upto June 2020	Progress from July- December 2020	Cumulative Progress
1	Design	72%	12%	84%
2	Procurement	79%	8%	97%
3	Demolition work of old plant	100%	0%	100%
4	Erection, Structure	65%	17%	82%
5	Installation	22%	11%	33%
6	Commissioning	0%	0%	0%
7	Total Progress	56%	8%	66%



Figure 2: Construction Works



Figure 3: Latest Picture of the Project Site (Construction going on)

2.0 Safeguard Compliance Performance of the Project

2.1 Compliance with the Environmental Provisions of National Legal Instruments

Status of Compliance with the environmental provisions of the National Legal Instruments Related to the project are Shown in Table 2.

Table 2: National Legal Instruments Related to the Emergency Assistance Project

Policies, Laws and Regulations	Responsible Agency/Ministry/ Authority	Potential Applicability	Compliance Status
National Environmental Policy, 1992	Ministry of Environment and Forest; Department of Environment	<ul style="list-style-type: none"> ➤ The policy sets out policies to prevent environmental pollution and natural resource degradation. ➤ The Policy states that Environmental Impact Assessments (EIAs) must be conducted before projects are undertaken. 	Complied with: EIA report was prepared and approved by DoE.
The Environment Conservation Act, 1995	Ministry of Environment and Forest; Department of Environment	<ul style="list-style-type: none"> ➤ According to this law no industrial unit or project shall be established or undertaken without obtaining, in the manner prescribed by rules, an Environmental Clearance 	Complied with: EIA report was prepared and approved by DoE.

		Certificate from the Director General.	
Environment Conservation Rules, 1997	Ministry of Environment and Forest; Department of Environment	<ul style="list-style-type: none"> ➤ The Rule sets out procedure for issuing Environmental Clearance Certificate. ➤ According to the Rule, proposed project is Red category project and needs to fulfill following requirements <ul style="list-style-type: none"> ❖ Prepare Initial Environmental Examination report. ❖ Report on the Environmental Management Plan (EMP). ❖ Prepare Environmental Impact Assessment report. ❖ Obtain No objection certificate of the local authority. 	Complied with: EIA report was prepared and approved by DoE. EMP was prepared. Obtain No objection certificate of the local authority and DoE.
National Land Use Policy, 2001	Ministry of Land	<ul style="list-style-type: none"> ➤ The policy provides guidelines for the protection of agricultural land, water bodies and the optimal use of other land, as well as for restriction or minimization of the acquisition of land for non-productive use. 	Complied with. The project area does not involve any land acquisition.
Bangladesh Climate Change Strategy and Action Plan (BCCSAP) 2009	Ministry of Environment and Forest	<ul style="list-style-type: none"> ➤ This strategy prioritizes adaptation and disaster risk reduction. The climate change action plan is built on six pillars. One of them is research and knowledge management to predict the likely scale and timing of climate change impacts on different sectors. 	Complied with.
Bangladesh Labour Act 2006	Ministry of Labour and Employment	<ul style="list-style-type: none"> ➤ The Act provides the guidance of employer's extent of responsibility and 	Complied with. Occupational Health and Safety

		workmen's extent of right to get compensation in case of injury by accident while working. Provides for safety of work force during construction period.	issues are addressed both in the EMP and Impacts and Mitigation measures are suggested there.
Bangladesh National Building Code, 2006	Ministry of Housing and Public Works	➤ Any planning, design and supervision of construction, repair, maintenance, modification and alteration of buildings, or any other work regulated by the Code shall be certified by a licensed engineer, architect or planner for its compliance with the provision of Code.	Complied with. Clearances from local authorities before start of any construction activity.

2. 2 SPS, 2009 compliance status

The status of the respective component sub-projects with regard to compliance status to ADB's policy statement (APS 2009) is shown in Table 3.

Table 3: ADB Safeguards Policy compliance Status for the Projects

ADB Safeguard Policy Statement	Status
Involuntary resettlement will be avoided whenever feasible.	complied
Where population displacement is unavoidable, it should be minimized.	No displacement
All lost assets acquired or affected will be compensated. Compensation is based on the principle of replacement cost.	NA
Each involuntary resettlement is conceived and executed as part of a development project or program. Affected persons need to be provided with sufficient resources to re-establish their livelihoods and homes with time bound action in co-ordination with civil works.	NA
Affected persons are to be fully informed and closely consulted.	complied
Affected persons are to be assisted to integrate economically and socially into host communities so that adverse impacts on the host communities are minimized and social harmony is promoted.	NA
The absence of a formal title to land is not a bar to ADB policy entitlements.	NA
Affected persons are to be identified and recorded as early as possible to establish their eligibility, through a census, which serves as a cut-off date, and prevents subsequent influx of encroachers.	NA
Particular attention will be paid to vulnerable groups including those without legal title to land or other assets; households headed by women; the elderly	NA

or disabled; and indigenous groups. Assistance must be provided to help them improve their socioeconomic status.	
The full resettlement costs will be included in the presentation of project costs and benefits.	NA

2.3 Compliance of environmental covenants from the ADB loan agreement

Status of Compliance with the environmental provisions of the ADB loan agreement are Shown in Table 4.

Table 4: Compliance with Environmental Considerations of Loan Agreements

Covenants	Reference	Compliance status
Environment		
<p>The borrower shall ensure, or cause APSCL to ensure, that the preparation, design, construction implementation, operation and decommissioning of the project and all project facilities comply with</p> <p>(a) All applicable laws and regulations of the Borrower relating to the environment, health, and safety;</p> <p>(b) The environmental safeguards;</p> <p>(c) The EARF; and</p> <p>(d) All measures and requirement set forth in the respective EIA, IEE and EMP, and any corrective or preventive actions set forth in a safeguards monitoring report</p>	<p>LA, Schedule 5, Para 2</p>	<p>a) All applicable laws and regulations of the Borrower relating to the environment, health, and safety were followed strictly in the project.</p> <p>b) The environmental safeguards and its related all safety measure were maintained in the project. Environmental Quality was monitored and report was submitted each month by EPC which was verified by an independent environmental Consultant to evaluate the environmental and social safeguard policy performance.</p> <p>c) The EARF is followed as per requirements.</p> <p>d) All measures and requirement set forth in the respective EIA, IEE and EMP, and any corrective or preventive actions set forth in a safeguard monitoring report is followed and maintained properly and updated time to time.</p>
Land Acquisition and Involuntary Resettlement		
<p>The borrower shall ensure, or cause APSCL to ensure, that all land and all</p>	<p>LA, Schedule 5,</p>	<p>In the case of APSCL, this type of issues does not arise due to the</p>

<p>rights-of-way required for the project, and all project facilities are made available to the works contractor in accordance with the schedule agrees under the related works contract and all land acquisition and resettlement activities are implemented in compliance with</p> <p>(a) all applicable laws and regulations of the borrower relating to land acquisition and involuntary resettlement;</p> <p>(b) the involuntary resettlement safeguards;</p> <p>(c) the RF; and</p> <p>(d) All measures and requirements set forth in the respective RP, and any corrective or preventive actions set forth in a safeguards monitoring report.</p>	<p>Para 3</p>	<p>project location. The project location is inside the premises of APSCCL own land. So, There was no requirement of Land Acquisition and Involuntary Resettlement throughout the project period.</p>
<p>Safeguards – Related provisions in bidding documents and works contracts</p>		
<p>The borrower shall ensure, or cause each projects executing agency to ensure, that all bidding documents and contracts for works contain provisions that require the contractor to:</p> <p>(a) Comply with the measures and requirements relevant to the contractor set forth in the EIA, IEE, the EMP, the RP and any small ethnic community peoples plan (to the extent they concern impacts on affected people during construction), and any corrective or preventive actions set out in a safeguards monitoring report;</p> <p>(b) Make available a budget for all such environmental and social measures;</p> <p>(c) Provide the borrower with a written notice of any unanticipated environmental,</p>	<p>LA, Schedule 5, Para 7</p>	<p>(a) APSCCL complied with the measures and requirements relevant to the contractor set forth in the EIA, IEE, the EMP, the RP and any small ethnic community peoples plan (to the extent they concern impacts on affected people during construction), and any corrective or preventive actions set out in a safeguards monitoring report;</p> <p>(b) Proper budget was allocated for all such environmental and social measures.</p> <p>(c) APSCCL followed that properly as per requirements and standard of ADB Social Safeguard Policy.</p> <p>(d) it was maintained as given guideline.</p> <p>(e) it was followed as per requirements.</p>

<p>resettlement or small ethnic community people risks or impacts that arise during construction, implementation or operation of the project that were not considered in the EIA, the IEE, the EMP, the RP or any small ethnic community peoples plan;</p> <p>(d) Adequately record the condition of roads, agricultural and other infrastructure prior to starting to transport materials and construction;</p> <p>(e) Fully reinstate pathways, other local infrastructure, and agricultural land to at least their pre-project condition upon the completion of construction.</p>		
Safeguards- Monitoring and Reporting		
<p>The borrower shall do the following or shall cause APSCL to do the following:</p> <p>(a) Submit semiannual safeguards monitoring reports to ADB and disclose relevant information from such reports to affected persons promptly upon submission;</p> <p>(b) If any unanticipated environmental and or social risks and impacts arise during construction, implementation or operation of the project that were not considered in the EIA, the IEE, the EMP or the RP, promptly inform ADB of the occurrence of such risks or impacts, with detailed description of the event and proposed corrective action plan;</p> <p>(c) No later than the mobilization of the turnkey contractor for</p>	<p>LA, Schedule 5, Para 7</p>	<p>a) The proper Safeguards monitoring already being carried out during pre-construction stage and is going on in construction and will be continued for post-construction phase or operation phase.</p> <p>b) It is followed as per the ADB guideline.</p> <p>c) One Environmental Expert is engaged already, and he is monitoring and giving valuable comments and feedback to APSCL.</p> <p>d) As per SEMP, we will follow the instruction.</p>

<p>APSCCL,s power plant, engage qualified and experienced external experts or qualified no-governmental organizations under a selection process and terms of reference acceptable to ADB, to verify information produced through the project monitoring process, and facilitated the carrying out of any verification by such external experts; and</p> <p>(d) Report any actual or potential breach of compliance with the measures and requirements set forth in the EMP or the RP promptly after becoming aware of the breach.</p>		
Labor standards		
<p>The borrower shall ensure that all works contract documents to be prepared under the project incorporate provisions and budget to the effect that contractors</p> <p>(a) Comply with all applicable labor laws and related international treaty obligations of the borrower and do not employ child labor as defined under Bangladesh law;</p> <p>(b) Provide safe working conditions for male and female workers;</p> <p>(c) Carry out HIV/ AIDS and human trafficking prevention and awareness campaigns in the campsites and corridors of influence;</p> <p>(d) Engage women worker as wage laborers depending on their skill; and</p> <p>(e) Provide equal wages for equal work between men and women</p>	<p>LA, Schedule 5, Para 10</p>	<p>a) APSCCL complies exiting all labor laws and related international treaty obligations of the borrower and not engaged any child labor at the project site.</p> <p>b) APSCCL is committed to provide safe working condition both for male and female workers and follow up regularly.</p> <p>c) APSCCL arrange this type awareness program at the foundation training of the worker.</p> <p>d) The women were engaged on the basis of their skill and there was no discrimination between man and women in terms of wage of equal work.</p> <p>e) It was maintained strictly.</p>

2.0 ENVIRONMENTAL STATUS

The APSCL 400 MW (East) project is classified as Environmental Category A as per the ADB’s SPS 2009, as significant impacts are envisioned. The related initial environmental examination (IEE) report, Environmental Impact Assessment Report (EIA) and Site specific Environmental Management Plan (SEMPs) has been prepared in accordance with ADB SPS 2009 requirements for environment category A projects and provide mitigation and monitoring measures, for no envisaged significant impacts, as a result of implementing the project. The environmental mitigation measures, as stipulated in the SEMP’s and in the obtained environmental permit, are monitored during the implementation of the programme. The environmental mitigation measures, as stipulated in SEMP’s for the current construction activity were monitored as a part of this EMR (July to December 2020). Environmental compliance report has been prepared based on site visit, sampling analysis and follow ups were tracked to observe corrective measures and desired progress.

3.1 Analytical Monitoring and Observations

Implementation of environmental monitoring plan during construction phase of the project (analytical) is shown in Table 5.

3.1.1 Air Quality Monitoring

During the construction phase of the power plant project, the important point sources of emissions were operations of construction equipment and machinery, vehicles carrying construction materials to the site and taking out construction debris from the site. If construction equipment, such as stone (aggregate) crusher is used at the site, this may result in significant emission of particulate matter during its operation. But to control it, the batching plant is situated in an isolated place outside of project area which has no impacts on the project and also to its adjacent places. Since the construction of the project involves significant earthworks that accelerate the increases the concentration of particulate matter in the air is also a concern. Ambient Air Quality was monitored by sampling from five different places (Figure 4) at Ashuganj 400 MW CCPP (East) project and the test results are presented in Table 6.

Table 5: Implementation of environmental monitoring plan during construction phase

SI No.	Issue	Key aspects	Monitoring Frequency	¹ Compliance status			Remarks
				C	PC	NC	
1.	Ambient air Quality	PM10, PM2.5 SPM, SO _x , NO _x , CO, CO ₂ .	Monthly	√			

SI N o.	Issue	Key aspects	Monitoring Frequency	¹ Compliance status			Re ma rks
				C	PC	NC	
2.	River water	Temp., DO, BODs, COD, Oil and Grease and heavy metals (Cr, Cd, Pb)	Monthly	√			
3.	Groundwater	Ground water level, pH, TDS, Ammonia, Nitrate, Phosphate, As, Fe, Mn and Total Coliforms, Faecal coliform, faecal streptococci, vibrio cholera	Once in 3 months	√			
4.	Soil quality	Cr, Cd, Grease, Pb and Oil and Grease	Once in 12 months	√			
5.	Noise level	Noise at different locations	Monthly	√			
6.	Drinking water	pH, Ammonia, Nitrate, Phosphate, As, Fe, Mn and Total Coliforms, Faecal coliform, faecal streptococci, vibrio cholera	Monthly	√			

¹C- Compliance, PC- Partially Compliance, NC- Non Compliance





Figure 4: Air quality monitoring

Table 6: Test Result of Ambient Air Quality

JULY 2020							
PARAMETER	DoE (Bangladesh) Standard *	IFC/World Bank Standard	L1	L2	L3	L4	L5
PM 2.5	65 µg/m ³	75 µg/m ³	28.85	19.10	24.61	33.71	28.42
PM 10	150 µg/m ³	150 µg/m ³	90.27	91.16	110.62	102.04	118.80
SPM	200 µg/m ³	NF	123.23	116.65	144.19	140.72	154.06
SO ₂	365 µg/m ³	125 µg/m ³	14.07	11.52	16.44	22.19	14.30
NO _x	NF	200 µg/m ³	19.32	18.67	23.04	33.16	26.06
CO	9 ppm	NF	0	0	0	0	0
AUGUST 2020							
PARAMETER	DoE (Bangladesh) Standard *	IFC/World Bank Standard	L1	L2	L3	L4	L5
PM 2.5	65 µg/m ³	75 µg/m ³	18.5	20.1	24.4	32.4	20.8

PM 10	150 µg/m ³	150 µg/m ³	74.7	90.9	100.6	113.2	94.2
SPM	200 µg/m ³	NF	98.8	123.2	129.3	142.3	121.5
SO ₂	365 µg/m ³	125 µg/m ³	10.9	12.6	11.8	13.8	10.8
NO _x	NF	200 µg/m ³	12.1	13.4	12.7	14.9	11.3
CO	9 ppm	NF	0	0	0	0	2
SEPTEMBER 2020							
PARAMETER	DoE (Bangladesh) Standard *	IFC/World Bank Standard	L1	L2	L3	L4	L5
PM 2.5	65 µg/m ³	75 µg/m ³	28.2	21.44	41.36	28.55	33.91
PM 10	150 µg/m ³	150 µg/m ³	101.62	97.74	118.32	90.27	103.56
SPM	200 µg/m ³	NF	133.20	116.25	159.55	112.94	140.73
SO ₂	365 µg/m ³	125 µg/m ³	8.12	14.51	11.76	16.31	10.07
NO _x	NF	200 µg/m ³	12.22	16.16	20.01	20.84	18.66
CO	9 ppm	NF	8	0	0	0	0
OCTOBER 2020							
PARAMETER	DoE (Bangladesh) Standard *	IFC/World Bank Standard	L1	L2	L3	L4	L5
PM 2.5	65 µg/m ³	75 µg/m ³	22.71	19.37	26.66	22.06	24.43
PM 10	150 µg/m ³	150 µg/m ³	98.43	90.16	82.01	101.35	96.63
SPM	200 µg/m ³	NF	126.82	107.32	114.05	120.66	123.98
SO ₂	365 µg/m ³	125 µg/m ³	12.23	14.72	18.16	13.37	10.11
NO _x	NF	200 µg/m ³	16.72	18.94	27.41	19.22	18.89
CO	9 ppm	NF	0	0	0	0	2
NOVEMBER 2020							
PARAMETER	DoE (Bangladesh) Standard *	IFC/World Bank Standard	L1	L2	L3	L4	L5
PM 2.5	65 µg/m ³	75 µg/m ³	37.73	43.21	39.17	40.16	33.23
PM 10	150 µg/m ³	150 µg/m ³	73.12	100.23	79.46	93.94	84.16
SPM	200 µg/m ³	NF	114.18	141.95	116.83	139.19	119.04
SO ₂	365 µg/m ³	125 µg/m ³	16.62	18.14	14.43	21.17	16.73
NO _x	NF	200 µg/m ³	20.94	28.23	27.46	19.17	19.16
CO	9 ppm	NF	0	0	0	0	0
DECEMBER 2020							
PARAMETER	DoE (Bangladesh) Standard *	IFC/World Bank Standard	L1	L2	L3	L4	L5
PM 2.5	65 µg/m ³	75 µg/m ³	25.59	42.23	43.72	48.81	44.29
PM 10	150 µg/m ³	150 µg/m ³	138.73	107.17	91.24	99.73	128.15
SPM	200 µg/m ³	NF	157.34	149.10	136.56	150.86	179.27
SO ₂	365 µg/m ³	125 µg/m ³	9.21	6.62	10.77	9.61	14.44
NO _x	NF	200 µg/m ³	16.98	18.17	18.20	19.92	19.61
CO	9 ppm	NF	3	0	2	0	2

*The Bangladesh National Ambient Air Quality Standards have been taken from the Environmental Conservation Rules, 1997 which was amended on 19th July 2005 vide S.R.O. No. 220-Law/2005.

PM2.5: PM2.5 are 2.5 micrometers in diameter or smaller, and can only be seen with an electron microscope. Fine particles are produced from all types of combustion, including motor vehicles, power plants, residential wood burning, forest fires, agricultural burning, and some industrial processes. The test result shows that the values of PM2.5 are within the standards.

PM10: Particle pollution, also called particulate matter or PM, is a mixture of solids and liquid droplets floating in the air. Some particles are released directly from a specific source, while others form in complicated chemical reactions in the atmosphere. PM10 are 2.5 to 10 micrometers in diameter. Sources include grinding operations and dust stirred up by vehicles on roads. From the above table of test results, it is seen that, for all the locations, the values are within the standard.

SOx: Sulfur oxides (SOx) are compounds of sulfur and oxygen molecules. Sulfur dioxide (SO₂) is the pre-dominant form found in the lower atmosphere. It is a colorless gas that can be detected by taste and smell in the range of 1,000 to 3,000 micrograms per cubic meter (µg/m³). Concentration of SO₂ ranges from 8.12 to 21.17 µg/m³ which are within the standard for air quality.

NOx: In atmospheric chemistry, NOx is a generic term for the nitrogen oxides that are most relevant for air pollution, namely nitric oxide (NO) and nitrogen dioxide (NO₂). These gases contribute to the formation of smog and acid rain, as well as tropospheric ozone. For all the location the values of NOx ranges from 11.3 to 28.23 µg/m³ which is within the standard.

CO: High levels of carbon monoxide are poisonous to humans and, unfortunately, it cannot be detected by humans as it has no taste or smell and cannot be seen. The main sources of additional carbon monoxide are motor vehicle exhaust and some industrial activities, such as making steel. Cigarette smoking and cooking is the major indoor sources of carbon monoxide. Concentration of CO was within the standard for all the sampling locations.

From the analysis of reporting period, it is observed that the concentrations of all these parameters are within the allowable limit according to DoE and IFC/World Bank Standard. So, the project construction activities do not hamper the air quality in the project area.

3.1.2 Noise Measurement

During construction stage, major source of noise is expected to stem from transport vehicles which include barges and trucks. Also, noise is expected to be produced from plant construction activities. The construction phase may be broadly classified into two different groups:

- General Site and Plant Construction,
- Water and Effluent Treatment Plant construction, and
- Access Road Construction.

The measured noise level in the construction site is summarized in Table 7. Noise level monitoring (Day time) are shown in Figure 5 and Figure 6.



Figure 5: Noise level monitoring (Day time; 6.00 AM-9.00 PM)

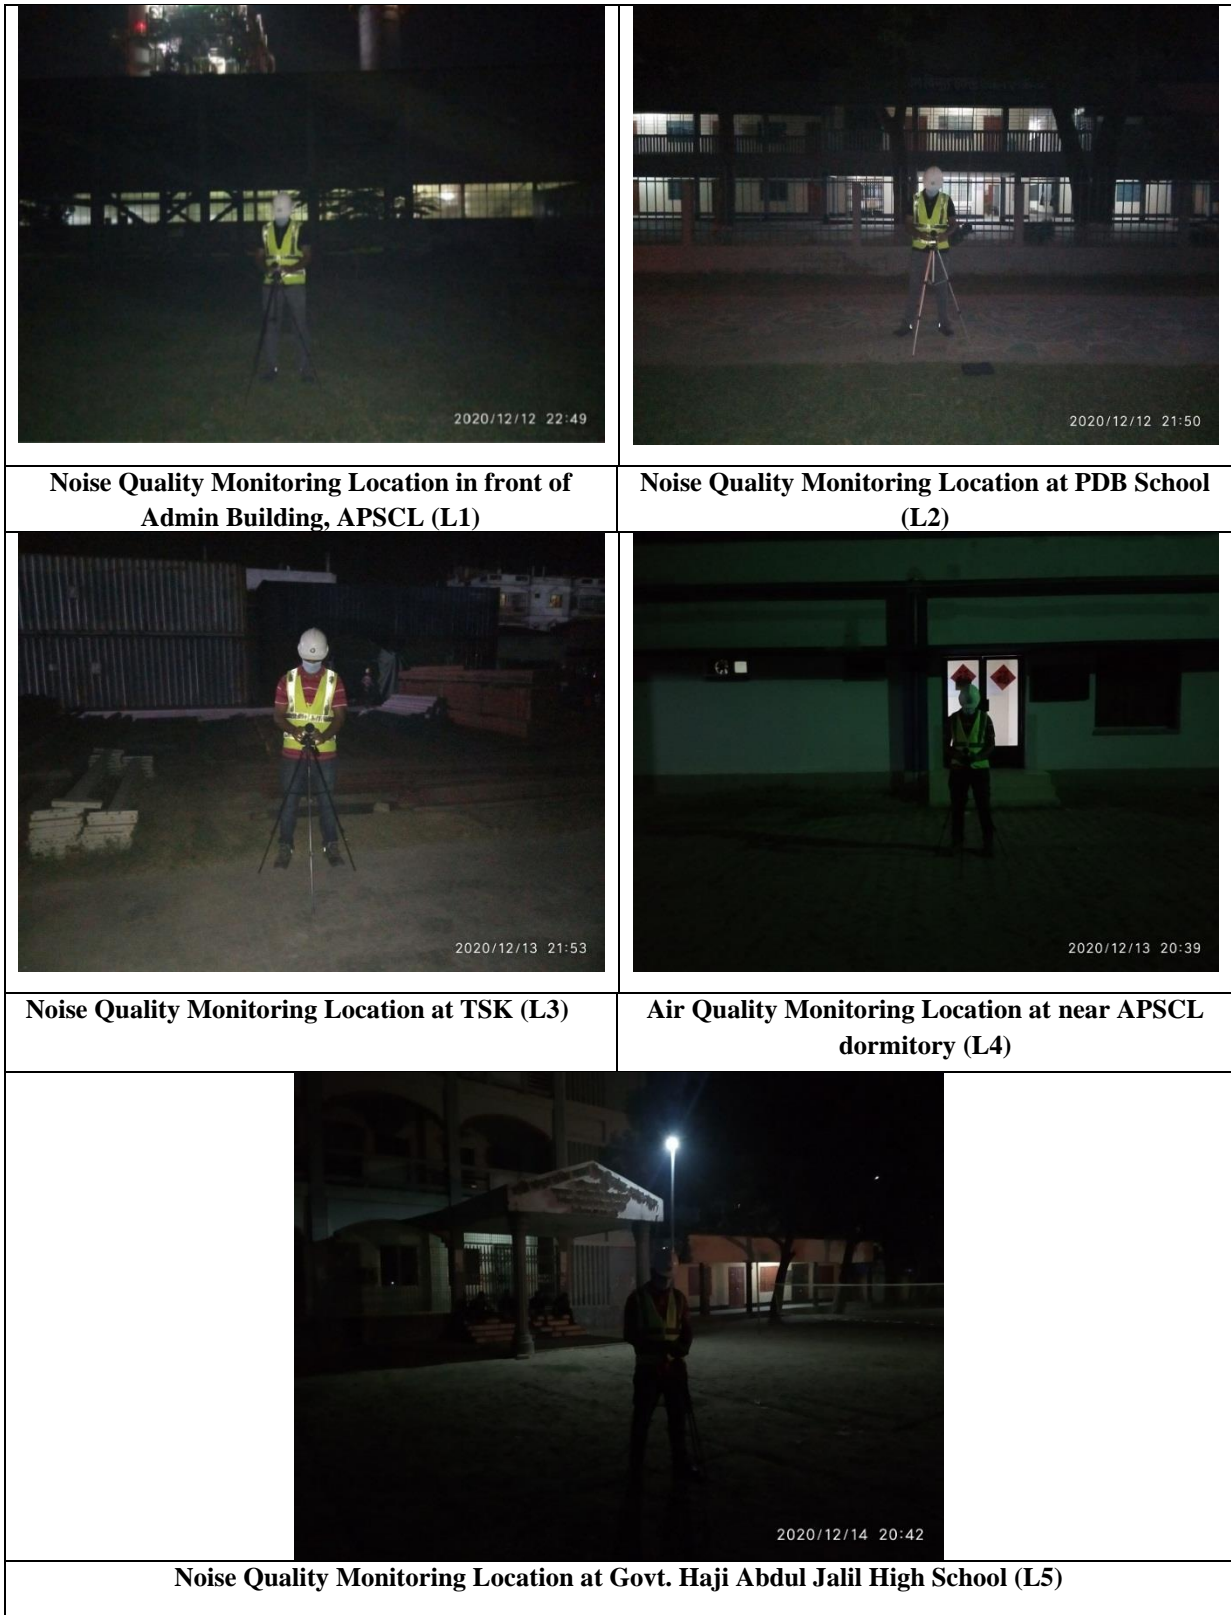


Figure 6: Noise level monitoring (Night time; 9.00 PM-6.00 AM)

From the analysis, it was found that the ambient noise qualities of the Project area were found within the allowable limit of DoE, Bangladesh & IFC Standard. It is also observed that in

the last six-months of 2020 noise level did not exceed the monitoring result of second semiannual of the previous year (2019). So, the project construction activities do not hamper the noise quality in the project area.

3.1.3 Water Quality Analysis

Health, Safety & Environment Division of APSCL has provided pure drinking water at several locations in APSCL plant area that also covers the under construction 400 MW CCPP (East) project to supply pure and safe drinking water to all the workers of this project and also to other employees, contractors and visitors of APSCL. Inside the project, drinking water jars are also filled with this pure drinking water for workers' convenience. The drinking, surface and groundwater sample were collected from the supplied drinking water, Meghna River and groundwater. The Meghna River passes through from East to West direction near the project area and there are few industries at the right bank of this river. So, the water of this river is less polluted that was also found from environmental monitoring.

3.1.3.1 Drinking Water Quality Analysis

The Drinking Water samples collected from different points as prescribed have been analyzed and shown in Table 8. Drinking water sampling is shown in Figure 7.

Table 7: Test Result of Noise Quality

JULY 2020							
(LAeq) dBA	DoE (Bangladesh) Standard *	IFC/World Bank Standard	L1	L2	L3	L4	L5
Day (Min)	75	70	51.8	51.2	47.1	57.1	43.3
Day(Max)	75	70	63.3	64.5	53.9	66.8	47.1
Night (Min)	70	70	46.1	48.2	46.3	52.3	42.4
Night(Max)	70	70	54.6	63.1	54.1	59.3	45.2
AUGUST 2020							
(LAeq) dBA	DoE (Bangladesh) Standard *	IFC/World Bank Standard	L1	L2	L3	L4	L5
Day (Min)	75	70	48.6	53.7	56.2	54.2	46.6
Day(Max)	75	70	65.1	61.1	64.7	68.4	59.1
Night (Min)	70	70	48.1	51.3	53.5	44.4	42.8
Night(Max)	70	70	54.2	56.2	61.0	58.3	52.2
SEPTEMBER 2020							
(LAeq) dBA	DoE (Bangladesh) Standard *	IFC/World Bank Standard	L1	L2	L3	L4	L5
Day (Min)	75	70	49.1	58.2	48.1	53.1	42.2

Day(Max)	75	70	60.3	64.4	62.2	44.4	52.3
Night (Min)	70	70	48.2	49.1	44.1	60.9	43.1
Night(Max)	70	70	53.2	51.6	55.2	58.7	49.4
OCTOBER 2020							
(LAeq) dBA	DoE (Bangladesh) Standard *	IFC/World Bank Standard	L1	L2	L3	L4	L5
Day (Min)	75	70	53.2	53.1	51.2	60.4	52.1
Day(Max)	75	70	61.3	65.1	57.4	65.9	55.4
Night (Min)	70	70	49.2	47.1	42.1	49.9	43.2
Night(Max)	70	70	52.2	57.2	52.1	57.2	47.4
NOVEMBER 2020							
(LAeq) dBA	DoE (Bangladesh) Standard *	IFC/World Bank Standard	L1	L2	L3	L4	L5
Day (Min)	75	70	52.2	56.4	48.1	62.6	48.8
Day(Max)	75	70	58.1	66.2	64.5	66.3	57.1
Night (Min)	70	70	46.1	47.3	51.0	50.4	44.2
Night(Max)	70	70	51.1	49.9	53.7	51.8	45.1
DECEMBER 2020							
(LAeq) dBA	DoE (Bangladesh) Standard *	IFC/World Bank Standard	L1	L2	L3	L4	L5
Day (Min)	75	70	56.6	51.1	54.7	57.9	49.1
Day(Max)	75	70	61.6	65.1	62.8	64.4	59.1
Night (Min)	70	70	47.8	46.1	49.9	52.1	48.4
Night(Max)	70	70	54.3	52.8	58.3	57.4	56.4

*According to the Department of Environment (ECR'1997), the standard for ambient noise level in the industrial zone is 75 and 70 decibels at day & night time respectively.



North-West side of the project area at canteen (D1)



South-west side of Project area near admin building purifier (D2)

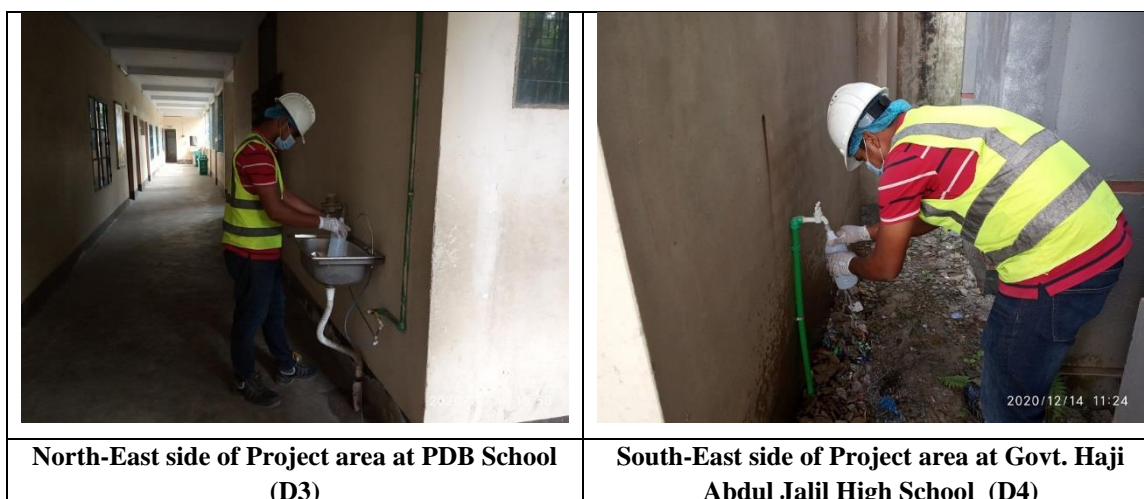


Figure 7: Drinking Water Sampling

Table 8: Drinking Water Quality Test Result

JULY 2020						
PARAMETER	DoE (Bangladesh) Standard *	IFC/World Bank Standard	D1	D2	D3	D4
pH	6.5 -8.5	6.5 -8.5	6.93	7.10	6.94	7.02
Ammonia	0.5 mg/l	---	<0.01	<0.01	<0.01	<0.01
Nitrate	10 mg/l	50 mg/l	<1	1.0	<1	<1
Phosphate	6 mg/l	---	0.05	<0.07	<0.07	<0.07
As	0.05 mg/l	0.01 mg/l	<0.003	<0.003	<0.003	<0.003
Fe	0.3 -1 mg/l	0.3 mg/l	0.83	0.1	0.2	<0.5
Mn	0.1 mg/l	0.5 mg/l	<0.1	<0.1	<0.1	<0.1
Total Coliform	0/100 ml	0/100 ml	0	0	0	0
Faecal Coliform	0/100 ml	0/100 ml	0	0	0	0
AUGUST 2020						
PARAMETER	DoE (Bangladesh) Standard *	IFC/World Bank Standard	D1	D2	D3	D4
pH	6.5 -8.5	6.5 -8.5	7.03	7.08	7.13	7.01
Ammonia	0.5 mg/l	---	<0.01	<0.01	<0.01	<0.01
Nitrate	10 mg/l	50 mg/l	<1	<1	<1	<1
Phosphate	6 mg/l	---	0.05	0.06	0.04	<0.05
As	0.05 mg/l	0.01 mg/l	<0.003	<0.001	<0.003	<0.003
Fe	0.3 -1 mg/l	0.3 mg/l	0.5	<0.1	0.1	<0.5
Mn	0.1 mg/l	0.5 mg/l	<0.1	<0.1	<0.1	<0.1
Total Coliform	0/100 ml	0/100 ml	0	0	0	0
Faecal Coliform	0/100 ml	0/100 ml	0	0	0	0
SEPTEMBER 2020						

PARAMETER	DoE (Bangladesh) Standard *	IFC/World Bank Standard	D1	D2	D3	D4
pH	6.5 -8.5	6.5 -8.5	6.98	7.03	7.03	7.12
Ammonia	0.5 mg/l	---	<0.01	<0.01	<0.01	<0.01
Nitrate	10 mg/l	50 mg/l	<1	<1	<1	<1
Phosphate	6 mg/l	---	<0.05	<0.05	<0.02	<0.05
As	0.05 mg/l	0.01 mg/l	<0.005	<0.005	<0.005	<0.005
Fe	0.3 -1 mg/l	0.3 mg/l	<0.5	<0.1	<0.1	<0.5
Mn	0.1 mg/l	0.5 mg/l	<0.1	<0.1	<0.1	<0.1
Total Coliform	0/100 ml	0/100 ml	0	0	0	0
Faecal Coliform	0/100 ml	0/100 ml	0	0	0	0

OCTOBER 2020

PARAMETER	DoE (Bangladesh) Standard *	IFC/World Bank Standard	D1	D2	D3	D4
pH	6.5 -8.5	6.5 -8.5	6.82	6.78	6.90	6.93
Ammonia	0.5 mg/l	---	<0.01	<0.01	<0.01	<0.01
Nitrate	10 mg/l	50 mg/l	2.0	<1.0	1.2	<1.0
Phosphate	6 mg/l	---	0.18	<0.07	<0.07	<0.07
As	0.05 mg/l	0.01 mg/l	<0.003	0.003	<0.003	<0.003
Fe	0.3 -1 mg/l	0.3 mg/l	<0.5	0.1	<0.1	<0.5
Mn	0.1 mg/l	0.5 mg/l	<0.1	<0.1	<0.1	<0.1
Total Coliform	0/100 ml	0/100 ml	0	0	0	0
Faecal Coliform	0/100 ml	0/100 ml	0	0	0	0

NOVEMBER 2020

PARAMETER	DoE (Bangladesh) Standard *	IFC/World Bank Standard	D1	D2	D3	D4
pH	6.5 -8.5	6.5 -8.5	6.79	7.12	6.98	7.12
Ammonia	0.5 mg/l	---	<0.01	<0.01	<0.01	0.01
Nitrate	10 mg/l	50 mg/l	<1	<1	<1	8
Phosphate	6 mg/l	---	0.07	0.07	0.08	0.3
As	0.05 mg/l	0.01 mg/l	0.01	0.003	0.003	0.102
Fe	0.3 -1 mg/l	0.3 mg/l	<0.5	<0.1	<0.1	<0.5
Mn	0.1 mg/l	0.5 mg/l	<0.1	<0.1	<0.1	0.1
Total Coliform	0/100 ml	0/100 ml	0	0	0	0
Faecal Coliform	0/100 ml	0/100 ml	0	0	0	0

DECEMBER 2020						
PARAMETER	DoE (Bangladesh) Standard *	IFC/World Bank Standard	D1	D2	D3	D4
pH	6.5 -8.5	6.5 -8.5	6.84	6.98	6.93	7.22
Ammonia	0.5 mg/l	---	<0.01	<0.01	<0.01	<0.01
Nitrate	10 mg/l	50 mg/l	<1	<1	<1	2
Phosphate	6 mg/l	---	0.08	<0.07	0.08	0.1
As	0.05 mg/l	0.01 mg/l	<0.003	0.005	0.004	0.008
Fe	0.3 -1 mg/l	0.3 mg/l	0.53	0.45	0.83	1.76
Mn	0.1 mg/l	0.5 mg/l	<0.1	<0.1	<0.1	0.1
Total Coliform	0/100 ml	0/100 ml	0	0	0	0
Faecal Coliform	0/100 ml	0/100 ml	0	0	0	0

*ECR'1997

pH: pH is a measure of the hydrogen ion concentration in water and indicates whether the water is acidic or alkaline. The measurement of alkalinity and acidity of pH is required to determine the corrosiveness of the water. From the test result of the drinking water, it is observed that pH values are within national standard ranges from 6.8 to 7.2.

Arsenic: Arsenic is a natural component of the earth's crust and is widely distributed throughout the environment in the air, water and land. It is highly toxic in its inorganic form. People are exposed to elevated levels of inorganic arsenic through drinking contaminated water, using contaminated water in food preparation and irrigation of food crops, industrial processes, having contaminated food and smoking cigarettes. The test result shows that the concentration of Arsenic is within the national standards for the project area except D4 location (outside of the project area) in November and notified the neighboring user not to use the water for drinking or cooking purpose.

Iron (Fe): Natural waters contain variable amounts of iron depending on the geological area and other chemical components of the waterway. Iron in groundwater is normally present in the ferrous or bivalent form [Fe⁺⁺] which is soluble. It is easily oxidized to ferric iron [Fe⁺⁺⁺] or insoluble iron upon exposure to air. The concentration of iron is within the national standard for the project area except location in December and the value varies between <0.01 and 1.76 mg/l.

Manganese (Mn): Mn values indicate the general nature of water quality. The values of Mn in all tested drinking water samples are within the Bangladesh Standard for Drinking Water Quality.

Total Coliform (TC): Total coliforms are a group of bacteria that are widespread in nature. All members of the total coliform group can occur in human feces, but some can also be present in animal manure, soil, and submerged wood and in other places outside the human body. Thus, the usefulness of total coliforms as an indicator of fecal contamination depends on the extent

to which the bacteria species found are fecal and human in origin. The values of TC were nil for the project area.

Faecal Coliform (FC): The presence of fecal coliform bacteria in aquatic environments indicates that the water has been contaminated with the fecal material of man or other animals. Faecal Coliform bacteria indicate the presence of sewage contamination of a waterway and the possible presence of other pathogenic organisms. The values of FC were nil for the project area.

From the analysis, it was found that all parameters of drinking water within standard limit of DoE, Bangladesh & WHO except As (November) and Fe (December) in D4. As mitigation measure all workers are suggested not to drink water from location D4 that is outside of the project. Pure drinking water is supplied by HS&E division of APSCL in the whole plant and this project site at suitable locations purified by six stages purification systems with alkaline RO and UV disinfection system. All employees and worker of the project are using the purified water for drinking purpose.

3.1.3.2 River Water Quality Analysis

The river water samples collected from different points as prescribed have been analyzed and shown in Table 9. River water sampling is shown in Figure 8.



Figure 8: River Water Sampling

Table 9: River Water Quality Test Result

JULY 2020					
PARAMETER	Baseline Data from EIA	DoE/IFC Standard	Upstream	Downstream	Outfall
Temperature	38 °C	-	24.1	23.8	20.7
Dissolved Oxygen (DO)	7.3 mg/l	-	6.2	6.6	6.4
BOD5	7 mg/l	-	0.1	0.1	1.0
COD	32 mg/l	-	3.2	3.0	4.8
Chromium (Total)	-	-	<0.02	<0.02	<0.02

Cadmium	-	-	<0.002	<0.002	<0.002
Lead (Pb)	<0.05 mg/l	-	<0.05	<0.05	<0.05
Oil & Grease	<5.5 mg/l	-	<1.0	<1.0	<1.0
AUGUST 2020					
PARAMETER	DoE (Bangladesh) Standard *	IFC/World Bank Standard	Upstream	Downstream	Outfall
Temperature	38 °C	-	26.1	25.9	21.1
Dissolved Oxygen (DO)	7.3 mg/l	-	5.8	5.8	6.1
BOD5	7 mg/l	-	0.2	0.1	0.6
COD	32 mg/l	-	2.0	2.0	4.4
Chromium (Total)	-	-	<0.02	<0.02	<0.02
Cadmium	-	-	<0.002	<0.002	<0.002
Lead (Pb)	<0.05 mg/l	-	<0.05	<0.05	<0.05
Oil & Grease	<5.5 mg/l	-	<1.0	0.8	1.6

SEPTEMBER 2020					
PARAMETER	DoE (Bangladesh) Standard *	IFC/World Bank Standard	Upstream	Downstream	Outfall
Temperature	38 °C	-	25.5	24.7	24.1
Dissolved Oxygen (DO)	7.3 mg/l	-	5.5	5.8	5.5
BOD5	7 mg/l	-	0.1	0.3	1.4
COD	32 mg/l	-	0.8	1.0	4.1
Chromium (Total)	-	-	<0.02	<0.02	<0.02
Cadmium	-	-	<0.002	<0.002	<0.002
Lead (Pb)	<0.05 mg/l	-	<0.05	<0.05	<0.05
Oil & Grease	<5.5 mg/l	-	<1.0	<1.0	2
OCTOBER 2020					
PARAMETER	DoE (Bangladesh) Standard *	IFC/World Bank Standard	Upstream	Downstream	Outfall
Temperature	38 °C	-	24.6	24.3	24.3
Dissolved Oxygen (DO)	7.3 mg/l	-	5.2	5.6	5.2
BOD5	7 mg/l	-	0.2	0.9	0.3
COD	32 mg/l	-	0.5	0.5	1.9
Chromium (Total)	-	-	<0.02	<0.02	<0.02
Cadmium	-	-	<0.002	<0.002	<0.002
Lead (Pb)	<0.05 mg/l	-	<0.05	<0.05	<0.05
Oil & Grease	<5.5 mg/l	-	<.0	<5.0	<5.0
NOVEMBER 2020					

PARAMETER	DoE (Bangladesh) Standard *	IFC/World Bank Standard	Upstream	Downstream	Outfall
Temperature	38 °C	-	22.6	20.7	20.4
Dissolved Oxygen (DO)	7.3 mg/l	-	5.8	5.4	4.8
BOD5	7 mg/l	-	0.1	0.1	0.6
COD	32 mg/l	-	1.0	1.0	2.8
Chromium (Total)	-	-	<0.02	<0.02	<0.02
Cadmium	-	-	<0.002	<0.002	<0.002
Lead (Pb)	<0.05 mg/l	-	<0.05	<0.05	<0.05
Oil & Grease	<5.5 mg/l	-	<5.0	<5.0	<5.0
DECEMBER 2020					
PARAMETER	DoE (Bangladesh) Standard *	IFC/World Bank Standard	Upstream	Downstream	Outfall
Temperature	38 °C	-	21.4	21.2	18.6
Dissolved Oxygen (DO)	7.3 mg/l	-	5.6	5.2	5.0
BOD5	7 mg/l	-	0.2	0.6	1.0
COD	32 mg/l	-	1.0	1.0	3.8
Chromium (Total)	-	-	0.04	0.02	<0.02
Cadmium	-	-	<0.002	<0.002	<0.002
Lead (Pb)	<0.05 mg/l	-	<0.05	<0.05	<0.05
Oil & Grease	<5.5 mg/l	-	<5.0	<5.0	<5.0

Dissolved Oxygen (DO): Dissolved oxygen is necessary for life of aquatic inhabitants. Decrease in DO values below the critical level of 3 mg/l causes death of most fishes and other aerobic aquatic organisms. The concentration of DO in water samples collected from the project site does not cross the baseline survey result obtained during EIA.

Biochemical Oxygen Demand (BOD5): Biochemical Oxygen Demand is supposed to measure the amount of food (or organic carbons) that bacteria can oxidize. The test results indicate the water has lower level of organic content.

Chemical Oxygen Demand (COD): Chemical Oxygen Demand is the total measurement of all chemicals in the water that can be oxidized. The value of COD was ranges from 0.5 to 4.8 mg/l.

From the above analysis result it can be concluded that there is a low negative impact of the project to the aquatic ecosystem.

3.1.3.3 Ground Water Quality Analysis

The Ground water samples collected from different points as prescribed have been analyzed and shown in Table 10. Ground water sampling is shown in Figure 9.



Figure 9: Ground water sampling

Table 10: Ground Water Quality

JULY 2020						
PARAMETER	Baseline Data from EIA	DoE/IFCStandard	G1	G2	G3	G4
pH	6.9	-	6.87	6.90	6.90	6.90
TDS	-	-	291	348	318	310
Ammonia	0.35 mg/l	-	<0.01	<0.01	<0.01	<0.01
Nitrate	2.15 mg/l	-	1.0	1.0	<1	1.0
Phosphate	3.65 mg/l	-	0.07	0.04	0.06	0.06
As	0.003 mg/l	-	<0.005	<0.005	<0.005	<0.005
Fe	0.4 mg/l	-	0.2	0.2	0.2	1.0
Mn	-	-	<0.1	<0.1	<0.1	<0.1
Total coliform	0/100 ml	-	0	0	0	0
Faecal Coliform	0/100 ml	-	0	0	0	0
OCTOBER 2020						
PARAMETER	Baseline Data from EIA	DoE/IFCStandard	G1	G2	G3	G4
pH	6.9	-	7.02	6.96	7.10	6.96
TDS	-	-	310	310	327	298

Ammonia	0.35 mg/l	-	<0.01	<0.01	<0.01	<0.01
Nitrate	2.15 mg/l	-	1.8	<1.0	1.5	<1.0
Phosphate	3.65 mg/l	-	0.1	0.07	0.1	<0.07
As	0.003 mg/l	-	<0.003	<0.003	<0.003	<0.003
Fe	0.4 mg/l	-	0.4	0.1	<0.3	0.3
Mn	-	-	0.1	<0.1	<0.1	<0.1
Total coliform	0/100 ml	-	0	0	0	0
Faecal Coliform	0/100 ml	-	0	0	0	0

pH: pH is a measure of the hydrogen ion concentration in water and indicates whether the water is acidic or alkaline. The measurement of alkalinity and acidity of pH is required to determine the corrosiveness of the water. From the test result of the ground water, it is observed that pH value ranges from 6.87 to 7.10.

Arsenic: Arsenic is a natural component of the earth's crust and is widely distributed throughout the environment in the air, water and land. It is highly toxic in its inorganic form. People are exposed to elevated levels of inorganic arsenic through drinking contaminated water, using contaminated water in food preparation and irrigation of food crops, industrial processes, having contaminated food and smoking cigarettes. The test result shows that the project has no negative influence on Arsenic concentration.

Iron (Fe): Natural waters contain variable amounts of iron depending on the geological area and other chemical components of the waterway. Iron in groundwater is normally present in the ferrous or bivalent form [Fe⁺⁺] which is soluble. It is easily oxidized to ferric iron [Fe⁺⁺⁺] or insoluble iron upon exposure to air. The concentration of iron varies from 0.1 and 0.4 mg/l.

Manganese (Mn): Mn values indicate the general nature of water quality. The values of Mn in all tested drinking water samples are within the Bangladesh Standard for drinking Water Quality.

Total Coliform (TC): Total coliforms are a group of bacteria that are widespread in nature. All members of the total coliform group can occur in human feces, but some can also be present in animal manure, soil, and submerged wood and in other places outside the human body. Thus, the usefulness of total coliforms as an indicator of fecal contamination depends on the extent to which the bacteria species found are fecal and human in origin. The values of TC were nil for the project area.

Faecal Coliform (FC): The presence of fecal coliform bacteria in aquatic environments indicates that the water has been contaminated with the fecal material of man or other animals. Faecal Coliform bacteria indicate the presence of sewage contamination of a waterway and the possible presence of other pathogenic organisms. The values of FC were nil for the project area.

From the analysis all parameters of ground water suggested that the project may has no influence on the quality.

3.1.4 Soil Quality Analysis

Soil is an important component of the environment and also is an integral component of the terrestrial ecosystem providing habitat and a source of food for key components of the food web. The soil samples collected from different points as prescribed have been analyzed and shown in Table 11.

Table 11: Soil Quality

PARAMETER	DoE (Bangladesh) Standard *	OSPAR Guidelines for Management of Dredged Material	Unit	L1	L2	L3
Chromium	-	150-200	ppm	21.11	17.32	15.18
Cadmium	-	1.0-2.5	ppm	<1.0	0.5	0.6
Lead	-	---	ppm	8.81	8.54	18.31
Oil and grease	-	50 mg/l	mg/kg	1.3	1.6	1.1

*no standard for soil.

3.2 Visual Monitoring and Observations

Implementation of environmental monitoring plan during construction phase of the project (visual) is shown in Table 12.

Table 12: Implementation of environmental Monitoring Plan during Construction Phase of the Project (Visual)

SI No.	Issue	Key aspects	Monitoring Frequency	¹ Compliance status			Remarks
				C	PC	NC	
1.	Traffic volume	Incoming & outgoing traffic, traffic movement records	Monthly	√			
2.	Site Security	Proper fencing, isolation of site from general access, marked passage for workers and visitors	Monthly	√			
3.	Personal Protective Equipment	Ensure every single person involved in the construction activity wear proper PPE	Monthly	√			
4.	Incident record & reporting	Documented record of all incident, accident, near misses etc. and its remedial process.	Monthly	√			
5.	Solid waste	Quantity of solid waste, segregation and disposal process	Monthly		√		Need to improve

SI No.	Issue	Key aspects	Monitoring Frequency	¹ Compliance status			Remarks
				C	PC	NC	
6.	Oily waste generation & disposal system	Quantity of oily waste, storage and disposal process	Monthly		√		Need to improve
7.	Worker's health	Monitoring process of worker's health	Monthly	√			
8.	Complain from neighbours	Any significant complain from neighbours and its remedial procedure	Monthly	√			
9.	Safety orientation & training of workers	Frequency of training & orientation of workers for safety	Monthly	√			
10.	Sanitation & drinking water facility to workers	Availability of safe drinking water and sanitation to the workers	Monthly	√			
11.	Site Drainage	Maintaining proper drainage	Monthly		√		Need to improve

.C- Compliance, PC- Partially Compliance, NC- Non Compliance

3.2.1 Traffic Volume

The Project is under construction phase now. The daily traffic details on day to day basis are being monitored and recorded in the registered book properly. Due to the pandemic situation traffics were not allowed to enter the plant and therefore, no such record was kept.

3.2.2 Site Security

CNTIC-CCOEC Consortium already constructed of site boundary fencing (Figure 10) to isolate the project site. Before entrance into project site, the employees were checked properly to restrict their entry with cigarette or other narcotics. Proper sign boards and pictorial safety instructions (Figure 10) were posted at different place of plant including the storing area of petroleum, highly flammable materials. With the incorporation of the security system at the main entry gate, overall site security system is come into a good shape and eventually will be under proper control.



Figure 10: Site Security & Safety Instruction Board

3.2.3 Personal Protective Equipment

The working personnel involved in the construction activities has to be under the safeguard of personal protective equipment (PPE) properly. Everyone was instructed to use proper PPE strictly. Figure 11 shows that, the workers involved in construction were using applicable PPEs. A list of PPEs that are supplied are listed in Table 13.

Table 13: List of Personal Protective Equipment Used in Project Site

SI No.	Type of work	Personal Protective Equipment used in site
1	Excavation	Safety Jacket, Safety Shoes, Helmet, Respiratory protection and Hand Gloves.
2	Construction	Safety Jacket, Safety Shoes, Helmet, Respiratory protection and Hand Gloves.

3	Welding	Helmet, Safety shoes, Eye face protection, protective clothing, Hand Gloves, Ear defence, Respiratory protection etc.
4	Scaffolding	Safety vests, Headwear, Safety footwear, Eye face protection, Slush Boots, Safety belt, Rain Suits, Hand protection.



Figure 11: Use of Proper PPEs

3.2.4 Incident Record & Reporting

Coordination of CNTIC-CCOEC Consortium with APSCL authority has developed to monitor any incident, accident, near misses, first aid recording and reporting system with proper format. It is observed that the Incident Record & Reporting are being properly monitored and recorded in the register book. There was no accident in the reporting time. However, some first aid recording was found. There is no Accident free Record Boards (displaying accident free days number, date, hours and time etc.) at the project site. If any incidental issue arises, immediately it has to be reported & recorded properly in the prescribed format.

3.2.5 Solid Waste

Solid wastes were generated from construction works (construction waste) and workers activities (kitchen waste, paper waste) at the project site. Waste inventory was properly

maintained and Table 14 describes the amount of waste generated according to their character during the reporting time.

**Table 14: Waste Inventory Log of CNTIC-CCOEC Consortium
(From July to December 2020)**

SI	Wastage Name	Wastage Classification	Wastage Type	Source of wastage	Wastage storage area	Storage quantity (kg)	Delivery quantity (kg)	Agreement	Remarks
1	Plastic Pipe	Hazardous	Solid	Construction Site	On site	12.2	12.2	Ok	Ok
2	Brick	Non-Hazardous	Solid	Construction Site	On site	53.1	53.1	Ok	Ok
3	Rubbish	Non-Hazardous	Solid	Construction Site	On site	33.7	33.7	Ok	Ok
4	Scrap	Hazardous	Solid	Construction Site	On site	15.7	15.7	Ok	Ok
5	Cable	Non-Hazardous	Solid	Construction Site	On site	12.3	12.3	Ok	Ok
6	Aggregate	Non-Hazardous	Solid	Construction Site	On site	70	70	Ok	Ok

3.2.6 Worker's Health and COVID Response

The CNTIC-CCOEC consortium will provide all kinds of treatment facilities and pay compensation according to Bangladesh Labor Law 2018. A medical center is already installed with first aid facility and an ambulance (Figure 12) is always available for any kind of emergency. Besides, an understanding with a local hospital for the emergency incident related to the worker's health of the plant and CNTIC-CCOEC Consortium has been established. To monitor the health condition of workers, body temperature (Figure 13) of each worker was checked two times a day and record was kept. Use of mask is mandatory and the entire worker was encouraged to sanitize their hand. Hand wash facilities were installed at different locations of project site and adequate materials were made available (Figure 14). During the period 92 Chinese people arrived and the last one arrived on 29th November 2020. After completing quarantine for 14 days and confirming COVID19 negative they were allowed to enter the site.



Figure 12: On-site Ambulance and furnished First Aid box



Figure 13: Daily Body Temperature Monitoring



Figure 14: On-site Hand Washing Facility & Supply of Hand Sanitizer, Soap & Mask

3.2.7 Grievance Redress mechanism

During the construction phase of a project, the complaints that may be anticipated are mostly related to poor environmental quality, lack of job opportunity, discrimination of wage and gender, unsafe working condition and so on. However, unforeseen issues may occur. CNTIC-CCOEC consortium has already established grievance redress mechanism. Complain from neighbours are duly recorded & adequate measures are taken accordingly. Though the project site is within the APSCL boundary, the North West side of the project site is near to some houses of neighbors. CNTIC-CCOEC Consortium has already set up a suggestion box in front of the project site to facilitate the neighbours to rise complains and take immediate measure to resolve the complaints. However, no such complaine was raised to resolve. APSCL as a project proponent also set a grievance redress committee (GRC) has been formed with following personals (Table 15) to rectify issue from different stockholders if raised.

Beside this as per Labor Law 2018 and Clause no 81 of Labor Rules 2015, APSCL has an active 'Safety Committee' to address and solve the internal grievance regarding Health, Safety and Environmental issues. APSCL has established and published 'Citizen's Charter' System

to address any grievance related to it and to rectify the problem rapidly by proper system. The web link of this is: https://apscl.portal.gov.bd/site/view/citizen_charter/.

APSCCL has also online Grievance Redress System. The useful links of these are: <http://apscl.gov.bd/site/page/929f626c-752c-4724-9680-845d0414883f/Process-Map> & <http://www.grs.gov.bd/>.

If anybody is affected by this 400 MW CCPP (East) project activities of APSCCL can give complain here. However, no grievance was recorded regarding this project.

Table 15: Members of the Committee of Grievance Redress (GRC)

SI No	Designation
1.	Project Director (Chief Engineer), Ashuganj 400 MW East Project
2.	Chief Engineer (O&M), APSCCL.
3.	Manager (HRM), APSCCL.
4.	Manager (HS&E), APSCCL.
5.	Deputy Manager (Security & Discipline), APSCCL.
6.	Assistant Manager (Security & Discipline), APSCCL.
7.	Chairman, Ashuganj Union Parishad, Member.

3.2.8 Safety orientation & training of workers

Training is essential to maintain the employee health and safety. Both theoretical and practical training (Figure 15) are conducted for the employees on the hazards, precautions, and procedures for the safe storage, handling, and use of all potentially harmful materials. Safety orientation & training for the workers are provided to all working personnel during the fresh enrolment /employment. CNTIC-CCOEC Consortium arrange routine safety training at definite time interval for the workers throughout the construction phase of the project. In addition, Training procedure will incorporate information from the Material Safety Data Sheets (MSDS) for potentially harmful materials. Toolbox meeting is arranged in regular basis. CNTIC arrange epidemic prevention knowledge trainings that teach the correct method of wearing face masks, hand washing and other protective measures considering the present condition of Corona Virus. CNTIC has taken some protective measures for safety of worker and other employee–Wear face masks in public area. Cover the mouth and nose with bent elbow or tissue when cough or sneeze, and dispose of the used tissue immediately.

- Wash hands frequently and thoroughly with soap and water or using alcohol-based hand rub to kill viruses that may be on hands.
- Maintain at least 1meter (3 feet) distance from others in public area such as workplace, corridors and canteen.

- Avoid touching eyes, nose and mouth with hands, which can transfer virus from the hands to eyes, nose or mouth and then enter the body.
- Keep the dormitory and workplace ventilated.



Figure 15: Toolbox meeting & training of workers

To improve the environmental, health & safety performance, monthly safety meeting was conducted each month with CNTIC and NEPC. Last safety meeting was conducted on 17/12/2020. About 19 issues were discussed to resolve within a set deadline. Responsibilities were also delegated to different persons from both CNTIC and NEPC for proper implementation of work. A summary of HSE management and monitoring is illustrated in Table 16.

Table 16: Summary of HSE Management

Areas to improve:		Housekeeping all area, Proper Safety, Housekeeping, Confined Space entry, toolbox, drainage system, Use of PPE, Incident reporting		
SI	Description	Till June 2020	From July-December 2020	Cumulative
1	Total Man-hour	1155492	294792	1450284
2	Safe man hours	1155492	294792	1450284
3	Fatal Accidents	0	0	0
4	Lost Time Injury (LTI)	0	0	0
5	Medical Treatment (MT)	4	0	4
6	First Aid Cases (FAC)	266	78	344
7	Health Incidents	0	0	0
8	Property Damage (PD)	0	0	0
9	Fire/Explosion	0	0	0
10	Security Incident	2	0	2
11	Near Miss	4	1	5
13	Environment (EN)	0	0	0
14	Job Transfer days	0	0	0

15	Total Days Lost	0	0	0
17	Tool Box Talks	599	30	629
18	HSE Weekly Meetings	85	12	97
19	HSE Inspections	63	12	75
20	HSE Induction	18	3	21
21	Grievance	0	0	0

3.2.9 Sanitation & Drinking Water Facility

Ground water is being supplied through the arrangement of piping network in the construction site and this water is available for the workers for the washing and toilet facilities. Besides, CNTIC-CCOEC Consortium Management supplies drinking water Jar for drinking purpose of the workers. Furthermore, robust drinking water purification system with reverse osmosis, UV disinfection system with ambient and cold water facility (Figure 16) has installed at three different suitable locations of this plant site by APSCL. Adequate toilets for male and female workers have already been constructed and cleaned time to time.

3.2.10 Site Drainage

In the Construction site, proper outer/inter drainage system has to be developed in the project site. At present there is no inner drainage at project site. After completion of construction works, necessary outer/inner drainage will be constructed. The existing outer drainage has been blocked by cement concrete slurry (Figure 17) and proper action was taken to clean it.



Figure 16: Pure Drinking Water & Sanitation facility to workers



Figure 17: Outer Site drainage condition

3.2.11 Dust Control

Dust poses negative impact of air quality as well as health especially in dry season. To control the dust water were sprayed regularly at least 3 times but if need more we spray that time. (Figure 18) and stock materials were kept covered.



Figure 18: Water spraying for dust control

3.2.12 Oily Waste Generation & Disposal System

Oily waste generation & disposal system is not required significantly during construction phase. However, CNTIC-CCOEC Consortium has assured that they will take necessary measures for the disposal of oily waste, when or if necessary.

4.0 CONCLUSION AND RECOMMENDATION

The environmental monitoring report is consist of 10th Semiannually environmental monitoring reporting based on monthly measured ambient air, noise, drinking water, ground and river water quality parameters. The work has been assigned EPC contractor CNTIC-CCOEC Consortium performed for the period of July to December 2020. Ambient air quality parameters were determined in the site with the help of high volume sampler and noise quality

was done by noise level meter. Drinking water, ground and surface water quality parameters were analyzed in the laboratory. All of the mitigation measures are taken following ADB Environmental Safeguard Policy 2009, IFC/World Bank Thermal Power plant guideline 2008 and 2017 and DoE, Bangladesh guideline.

From the analysis, it is found that the ambient air quality results found within DoE standards. This value are cumulative with surrounding ambient air and noise level. SO_x and CO are not a problem of the construction period of the power plant. But SPM, PM_{2.5}, PM₁₀ level during the construction period of the power plant is controlled by taking proper mitigation measures and spraying of water.

Noise level quality of Ashuganj CCPP has also been measured by EPC contractor. According to the measurement, the noise level around the plant area found within the allowable limit of Industrial zone both day and also at night time. The noise level is controlled by using modern, new and fine-tuned equipment.

Surface water quality parameter at Meghna River was performed to evaluate whether this plant poses any detrimental effect on the water environment. From the analysis, it has been found that the project does not contaminate water pollution to the natural environment. Otherwise, any spill is not detected next to riverbeds around the worksite (oils, concrete waste or conglomerate asphalt, any colour changes of the water, etc.). Drinking and groundwater quality is also found good.

House-keeping is also in good condition at the plant site. All solid, liquid and hazardous waste are disposed of the designated container at the plant site. Most of the solid wastes are disposed of by landfill. The usable solid wastes are handed over to proper party for recycling.

Finally, it can be concluded that the plant has a minor detrimental impact for short period on the environment in terms of ambient air during the construction period. The plant provides a good working environment for the workers.

ANNEX-I: PHOTO APPENDIX



Construction of Central Control Building (CCB)



Construction of Turbine Hall



Unit Transformer



Hydrogen Storage Tank



Superstructure of HRSG and Exhaust Stack



Gas RMS



Construction of chemical plant



Construction of water intake plant



Batching plant

ANNEX-II: MONITORING LOCATIONS

Category	Indication of Location	GPS Co-ordinate		Specific Location	Distance (m)
		Latitude	Longitude		
Ambient air quality	Location-1 (L1)	24°02'38.5'' N	91°1'0.0'' E	South-West side of Project area near APSCCL Admin building.	182
	Location-2 (L2)	24°02'30.5'' N	91°0'42.2'' E	South-west side of Project area near PDB High School.	702
	Location-3 (L3)	24°02'34.7'' N	91°01'8.7'' E	South-East side of Project area at TSK.	756.3
	Location-4 (L4)	24°02'58.5'' N	91°01'23.9'' E	North-East side of Project area near APSCCL dormitory.	750
	Location-5 (L5)	24°02'31.7'' N	91°0'30.3'' E	South-West side of Project area near Haji Abdul Jalil High School.	1045
Noise Level	Location-1	24°02'38.5'' N	91°1'0.0'' E	South-West side of Project area near APSCCL Admin building.	183
	Location-2	24°02'30.5'' N	91°0'42.2'' E	South-west side of Project area near PDB High School.	712.5
	Location-3	24°02'34.7'' N	91°01'8.7'' E	South-East side of Project area at TSK.	756.3
	Location-4	24°02'58.5'' N	91°01'23.9'' E	North-East side of Project area near APSCCL dormitory.	751.3
	Location-5	24°02'31.7'' N	91°0'30.3'' E	South-West side of Project area near Haji Abdul Jalil High School.	1048.2
River Water	Upstream	24°02'53.1'' N	91°01'3.1'' E	North-West side of Project area near the project location	385.87
	Downstream	24°02'44.0'' N	91°00'33.2'' E	North-West side of Project area and near Ashuganj Chor Sonarampur.	905.93
	Outfall	24°02'40.3'' N	91°01'10.8'' E	South-East side of Project area near APSCCL power plant area.	138.71

Category	Indication of Location	GPS Co-ordinate		Specific Location	Distance (m)
		Latitude	Longitude		
Drinking Water	Location-1 (D1)	24° 2'39.43"N	91° 0'58.29"E	North-West side of the project area at canteen	60.3
	Location-2 (D2)	24° 2'35.47"N	91°01'6.38"E	South-west side of Project area at admin building (Purifier)	41.53
	Location-3 (D3)	24°02'38.86'' N	91°01'.10'' E	South-west side of Project area near PDB High School.	56.51
	Location-4 (D4)	24° 2'38.51"N	91°01'1.10"E	South-West side of Project area at Haji Abdul Jalil High School.	55.63
Soil Quality	Location-1 (L1)	24°02' 41.8'' N	91° 1' 3.83'' E	Inside the project site	8.5
	Location-2 (L2)	24° 2'40.27'' N	91° 1'6.05"E	Inside the project site	10.6
	Location-3 (L3)	24°02' 39.72'' N	91° 1' 8.25'' E	Inside the project site	5.3

ANNEX-III: LABORATORY TEST RESULT



Adroit Environment Consultants Ltd.

A House of Complete Environmental Management Solutions

AECL LABORATORY ANALYSIS REPORT AMBIENT AIR QUALITY TEST REPORT

: **776**
: Ashuganj 400MW CCPP (East)
: Ashuganj, Brahmanbaria.

Project Location

Description of Sample : Ambient Air
Sample Collector : Adroit Environment Consultants Ltd. (Monitoring team).
Sampling date : 4th - 5th July, 2020
Reporting date : 20th July, 2020

Description of analysis

S N	Parameters	Method	Test Duration (hours)	Unit	24°2'3	24°2'3	24°2'3	24°2'58	24°2'31	Bangladesh (DoE) Standard	IFC /World Bank Standard
					8.5° N 91°1' 0.0"E (L1)	0.5° N 91°0'4 2.2" E (L2)	4.7° N 91°1'8. 7" E (L3)	.5° N 91°1'23 .9" E (L4)	.7° N 91°00'3 0.3" E (L5)		
1	PM _{2.5}	Gravimetric	24	µg/m ³	28.85	19.10	24.61	33.71	28.42	65	75
2	PM ₁₀	Gravimetric	24	µg/m ³	90.27	91.16	110.62	102.04	118.80	150	150
3	SPM	Gravimetric	8	µg/m ³	123.23	116.65	144.19	140.72	154.06	200	NF
4	SO ₂	West-Geake	24	µg/m ³	14.07	11.52	16.44	22.19	14.30	365	125
5	NO _x	Jacob and Hochheiser	24	µg/m ³	19.32	18.67	23.04	33.16	26.06	100	200
6	CO	CO/O ₃ Meter	1	ppm	0	0	0	0	0	35	NF

(NF – not found, DoE – Department of Environment.), *1-hour standard Not Found

Note: This monitoring report was usually accomplished by - Respirable Dust Sampler (Model-Envirotech India APM-460BL) and Fine Particulate Sampler (Model- Envirotech India AAS-127BL).

- | | |
|--|---|
| 1. Fine Particulate Matter (PM _{2.5}). | 4. Oxides of Nitrogen (NO _x). |
| 2. Respirable Dust Content (PM ₁₀). | 5. Oxides of Sulfur (SO ₂). |
| 3. Suspended Particulate Matter (SPM). | 6. Carbone Mono-Oxide (CO). |

Comment: From the aforementioned results it is discernible that, all the parameters are inside the allowable limits.

Md. Faisal Bin Mahmud
Sr. Chemist

Md. Saiful Islam
General Manager

2/12, Humayun Road (2nd Floor), Block-B, Mohammadpur, Dhaka-1207 Tel : +88-02-9116712-13
Mob: 01733376609-10, Fax: +88-02-9116714, Email: nukhan05@gmail.com, aecldhaka@gmail.com

www.aecl-bd.org



Adroit Environment Consultants Ltd.

A House of Complete Environmental Management Solutions



AECL LABORATORY ANALYSIS REPORT AMBIENT NOISE QUALITY TEST REPORT

Member of AECL : **776**
Project Name : **Ashuganj 400MW CCPP (East)**
Project Location : **Ashuganj, Brahmanbaria**
Description of Sample : **Ambient Noise**
Sample Collector : **Adroit Environment Consultants Ltd. (Monitoring team)**
Sampling date : **4th July, 2020**
Reporting date : **20th July, 2020**

Description of analysis

SN.	Site Location	Site Condition	Concentrations present (LA _{eq}) dBA.			
			Day Time		Night Time	
			Minimum	Maximum	Minimum	Maximum
01	Test Result in South-West side of Project area near APSCL Admin building, (location # 01) N- 24°02'38.5" E-091°01' 0.0"	Construction Stage	51.8	63.3	46.1	54.6
02	Test Result in South-West side of Project area near PDB High School, (location # 02) N-24°02'30.5" E-091°0'42.2"	Construction Stage	51.2	64.5	48.2	63.1
03	Test Result in South-East side of Project area near TSK, (location # 03) N- 24°02'34.7" E-091°01'8.7"	Construction Stage	47.1	53.9	46.3	54.1
04	Test Result in North-East side of Project area near APSCL dormitory, (location # 04) N- 24°02'58.5" E-091°01'23.9"	Construction Stage	57.1	66.8	52.3	59.3
05	Test Result in South-West side of Project area near Haji Abdul Jalil High School, (location # 05) N- 24°02'31.7" E-091°00'30.3"	Construction Stage	43.3	47.1	42.4	45.2
DoE (Bangladesh) Standard for Industrial area			75		70	
IFC/International Standard for Industrial/Commercial Zone			70		70	

All units are in (LA_{eq}) dBA.

Note: This noise data was usually accomplished by – CEM Sound Level Meter (Model – DT 8850)

Comment: According to the Department of Environment (ECR'1997), the standard for ambient noise level in the industrial zone is 75 and 70 decibels at day & night time respectively. The results were found within the limit as per DoE Standards.

Md. Faisal Bin Mahmud
Sr. Chemist

Md. Saiful Islam
General Manager

2/12, Humayun Road (2nd Floor), Block-B, Mohammadpur, Dhaka-1207 Tel : +88-02-9116712-13
Mob: 01733376609-10, Fax: +88-02-9116714, Email: nukhan05@gmail.com, aeclbdhaka@gmail.com

www.aecl-bd.org



Adroit Environment Consultants Ltd.

A House of Complete Environmental Management Solutions



AECL LABORATORY ANALYSIS REPORT DRINKING WATER QUALITY TEST REPORT

Memorandum # AECL : 776
Project Name : Ashuganj 400MW Combined Cycle Power Plant (East)
Project Location : Ashuganj, Brahmanbaria.

Sample Collector : Adroit Environment Consultants Ltd (Monitoring team).
Description of Sample : Drinking Water
Sample Location : Ashuganj, Brahmanbaria. (Inside project area)
Sampling date : 4th July, 2020
Reporting date : 20th July, 2020

Description of analysis

Name of the Parameter	Concentration Present					DoE (Bangladesh) Standard *	WHO Standard	Unit	Method of analysis
	(D1)	(D2)	(D3)	(D4)	(D5)				
pH	6.93	7.10	6.94	7.02	7.11	6.5 – 8.5	-	-	pH Meter
Ammonia	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	Photometric
Nitrate	<1	1.0	<1	<1	1.1	10	50	mg/l	Potentiometric
Phosphate	0.05	<0.07	<0.07	<0.07	<0.05	6	-	mg/l	Photometric
As	<0.003	<0.003	<0.003	<0.003	<0.003	0.05	0.01	mg/l	Atomic Absorption Spectrophotometer
Fe	0.83	0.1	0.2	<0.5	0.6	0.3-1.0	-	mg/l	Spectrophotometer
Mn	<0.1	<0.1	<0.1	<0.1	<0.1	0.1	0.5	mg/l	Atomic Absorption Spectrophotometer
Total Coliform	0	0	0	0	0	0	0	n/100 ml	Membrane Filter Technique
Fecal Coliform	0	0	0	0	0	0	0	n/100 ml	Membrane Filter Technique

* DoE Standard for drinking water.

Comment: From the above analysis result it is discernible that, all the parameters conform to the given standards.

Md. Faisal Bin Mahmud
Sr. Chemist

Md. Saiful Islam
General Manager

2/12, Humayun Road (2nd Floor), Block-B, Mohammadpur, Dhaka-1207 Tel : +88-02-9116712-13
Mob: 01733376609-10, Fax: +88-02-9116714, Email: nukhan05@gmail.com, aeclhaka@gmail.com

www.aecl-bd.org



Adroit Environment Consultants Ltd.

A House of Complete Environmental Management Solutions



AECL LABORATORY ANALYSIS REPORT GROUND WATER QUALITY TEST REPORT

Memo # AECL : 776
 Project Name : Ashuganj 400MW Combined Cycle Power Plant (East)
 Project Location : Ashuganj, Brahmanbaria.

 Sample Collector : Adroit Environment Consultants Ltd. (Monitoring team).
 Description of Sample : Ground Water
 Sample Location : Ashuganj, Brahmanbaria. (Inside project area)
 Sampling date : 4th July, 2020
 Reporting date : 20th July, 2020

Description of analysis

Name of the Parameter	Concentration Present				DoE (Bangladesh) Standard *	WHO Standard	Unit	Method of analysis
	(G1)	(G2)	(G3)	(G4)				
pH	6.87	6.96	6.90	6.97	6.5 – 8.5	-	-	pH Meter
TDS	291	348	318	310	1000	-	Mg/l	TDS Meter
Ammonia	<0.01	<0.01	<0.01	<0.01	0.5	-	mg/l	Photometric
Nitrate	1.0	1.0	<1	1.0	10	50	mg/l	Potentiometric
Phosphate	0.07	0.04	0.06	0.06	6	-	mg/l	Photometric
As	<0.005	<0.005	<0.005	<0.005	0.05	0.01	mg/l	Atomic Absorption Spectrophotometer
Fe	0.2	0.2	0.2	1.0	0.3-1.0	-	mg/l	Spectrophotometer
Mn	<0.1	<0.1	<0.1	<0.1	0.1	0.5	mg/l	Atomic Absorption Spectrophotometer
Total Coliform	0	0	0	0	0	0	n/100 ml	Membrane Filter Technique
Fecal Coliform	0	0	0	0	0	0	n/100 ml	Membrane Filter Technique

* DoE Standard for drinking water (No standard found for ground water)

Comment: From the above analysis it is discernible that all the parameters conform to the standards.

Md. Faisal Bin Mahmud
Sr. Chemist

Md. Saiful Islam
General Manager

2/12, Humayun Road (2nd Floor), Block-B, Mohammadpur, Dhaka-1207 Tel : +88-02-9116712-13
Mob: 01733376609-10, Fax: +88-02-9116714, Email: nukhan05@gmail.com, aeclhaka@gmail.com

www.aecl-bd.org



Adroit Environment Consultants Ltd.

A House of Complete Environmental Management Solutions



AECL LABORATORY ANALYSIS REPORT SURFACE WATER QUALITY TEST REPORT

Memo No: **AECL : 776**
Project Name : **Ashuganj 400MW Combined Cycle Power Plant (East)**
Project Location : **Ashuganj, Brahmanbaria.**

Sample Collector : Adroit Environment Consultants Ltd (Monitoring team)
Description of Sample : River Water
Sample Location : Ashuganj, Brahmanbaria (Near project area)
Sampling date : **4th July, 2020**
Reporting date : **20th July, 2020**

Description of analysis

Name of the Parameter	Concentration present			DoE (Bangladesh) Standard *	Unit	Method of analysis
	Upstream	Downstream	Outfall			
Temperature	24.1	23.8	20.7	40	°C	Mercury filled thermometer
Dissolved Oxygen (DO)	6.2	6.6	6.4	4.5-8	mg/l	DO meter
BOD ₅	0.1	0.1	1.0	50	mg/l	5-day BOD test
COD	3.2	3.0	4.8	200	mg/l	Open Reflux
Chromium	<0.02	<0.02	<0.02	0.5	mg/l	Atomic Absorption Spectrophotometer
Cadmium	<0.002	<0.002	<0.002	0.5	mg/l	Atomic Absorption Spectrophotometer
Pb	<0.05	<0.05	<0.05	0.1	mg/l	Atomic Absorption Spectrophotometer
Oil & Grease	<1.0	<1.0	<1.0	10	mg/l	APHA 5520.B

*DoE Standard for Inland Surface Water (No standard was found for River Water)

Comment: From the above analysis result it is found that, all the parameters are within allowable limit.

Md. Faisal Bin Mahmud
Sr. Chemist

Md. Saiful Islam
General Manager

2/12, Humayun Road (2nd Floor), Block-B, Mohammadpur, Dhaka-1207 Tel : +88-02-9116712-13
Mob: 01733376609-10, Fax: +88-02-9116714, Email: nukhan05@gmail.com, aeclhdhaka@gmail.com

www.aecl-bd.org





Adroit Environment Consultants Ltd.

A House of Complete Environmental Management Solutions

AECL LABORATORY ANALYSIS REPORT AMBIENT AIR QUALITY TEST REPORT

Memo # **AECL** : **781**
Project Name : **Ashuganj 400MW CCPP (East)**
Project Location : **Ashuganj, Brahmanbaria.**

Description of Sample : **Ambient Air**
Sample Collector : **Adroit Environment Consultants Ltd. (Monitoring team).**
Sampling date : **16th ~ 18th August, 2020**
Reporting date : **27th August, 2020**

Description of analysis

S N	Parameters	Method	Test Duration (hours)	Unit	24°2'3	24°2'3	24°2'3	24°2'58	24°2'31	Bangladesh (DoE) Standard	IFC /World Bank Standard
					8.5" N 91°1' 0.0"E (L1)	0.5" N 91°0'4 2.2"E (L2)	4.7" N 91°1'8. 7"E (L3)	.5" N 91°1'23 .9"E (L4)	.7" N 91°00'3 0.3"E (L5)		
1	PM _{2.5}	Gravimetric	24	µg/m ³	18.5	20.1	24.4	32.4	20.8	65	75
2	PM ₁₀	Gravimetric	24	µg/m ³	74.7	90.9	100.6	113.2	94.2	150	150
3	SPM	Gravimetric	8	µg/m ³	98.8	123.2	129.3	142.3	121.5	200	NF
4	SO ₂	West-Geake	24	µg/m ³	10.9	12.6	11.8	13.8	10.8	365	125
5	NO _x	Jacob and Hochheiser	24	µg/m ³	12.1	13.4	12.7	14.9	11.3	100	200
6	CO	CO/O ₃ Meter	1	ppm	0	0	0	0	2	35	NF

(NF - not found, DoE - Department of Environment.), *1-hour standard Not Found

Note: This monitoring report was usually accomplished by - Respirable Dust Sampler (Model-Envirotech India APM-460BL) and Fine Particulate Sampler (Model- Envirotech India AAS-127BL).

1. Fine Particulate Matter (PM_{2.5}).
2. Respirable Dust Content (PM₁₀).
3. Suspended Particulate Matter (SPM).
4. Oxides of Nitrogen (NO_x).
5. Oxides of Sulfur (SO₂).
6. Carbene Mono-Oxide (CO).

Comment: From the aforementioned results it is discernible that, all the parameters are inside the allowable limits.

Md. Faisal Bin Mahmud
Sr. Chemist

Md. Saiful Islam
General Manager

2/12, Humayun Road (2nd Floor), Block-B, Mohammadpur, Dhaka-1207 Tel : +88-02-9116712-13
Mob: 01733376609-10, Fax: +88-02-9116714, Email: nukhan05@gmail.com, aecldhaka@gmail.com

www.aecl-bd.org



Adroit Environment Consultants Ltd.

A House of Complete Environmental Management Solutions

AECL LABORATORY ANALYSIS REPORT **AMBIENT NOISE QUALITY TEST REPORT**

Memo # AECL : 781
Project Name : Ashuganj 400MW CCPP (East)
Project Location : Ashuganj, Brahmanbaria

Description of Sample : Ambient Noise
Sample Collector : Adroit Environment Consultants Ltd. (Monitoring team)
Sampling date : 16th ~ 18th August, 2020
Reporting date : 27th August, 2020

Description of analysis

SN.	Site Location	Site Condition	Concentrations present (LA _{eq}) dBA.			
			Day Time		Night Time	
			Minimum	Maximum	Minimum	Maximum
01	Test Result in South-West side of Project area near APSCS Admin building, (location # 01) N- 24°02'38.5" E-091°01' 0.0"	Construction Stage	48.6	65.1	48.1	54.2
02	Test Result in South-West side of Project area near PDB High School, (location # 02) N-24°02'30.5" E-091°0'42.2"	Construction Stage	53.7	61.1	51.3	56.2
03	Test Result in South-East side of Project area near TSK, (location # 03) N- 24°02'34.7" E-091°01'8.7"	Construction Stage	56.2	64.7	53.5	61.0
04	Test Result in North-East side of Project area near APSCS dormitory, (location # 04) N- 24°02'58.5" E-091°01'23.9"	Construction Stage	54.2	68.4	44.4	58.3
05	Test Result in South-West side of Project area near Haji Abdul Jalil High School, (location # 05) N- 24°02'31.7" E-091°00'30.3"	Construction Stage	46.6	59.1	42.8	52.2
DoE (Bangladesh) Standard for Industrial area			75		70	
IFC/International Standard for Industrial/Commercial Zone			70		70	

All units are in (LA_{eq}) dBA.

Note: This noise data was usually accomplished by – CEM Sound Level Meter (Model – DT 8850)

Comment: According to the Department of Environment (ECR'1997), the standard for ambient noise level in the industrial zone is 75 and 70 decibels at day & night time respectively. The results were found within the limit as per DoE Standards.

Md. Faisal Bin Mahmud
Sr. Chemist

Md. Saiful Islam
General Manager

2/12, Humayun Road (2nd Floor), Block-B, Mohammadpur, Dhaka-1207 Tel : +88-02-9116712-13
Mob: 01733376609-10, Fax: +88-02-9116714, Email: nukhan05@gmail.com, aecl dhaka@gmail.com

www.aecl-bd.org



Adroit Environment Consultants Ltd.

A House of Complete Environmental Management Solutions



AECL LABORATORY ANALYSIS REPORT DRINKING WATER QUALITY TEST REPORT

Memo No. : **781**
Project Name : Ashuganj 400MW Combined Cycle Power Plant (East)
Project Location : Ashuganj, Brahmanbaria.

Sample Collector : Adroit Environment Consultants Ltd (Monitoring team).
Description of Sample : Drinking Water
Sample Location : Ashuganj, Brahmanbaria. (Inside project area)
Sampling date : 16th ~ 18th August, 2020
Reporting date : 27th August, 2020

Description of analysis

Name of the Parameter	Concentration Present				DoE (Bangladesh) Standard *	WHO Standard	Unit	Method of analysis
	(D1)	(D2)	(D3)	(D4)				
pH	7.03	7.08	7.13	7.01	6.5 – 8.5	-	-	pH Meter
Ammonia	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	Photometric
Nitrate	<1	<1	<1	<1	10	50	mg/l	Potentiometric
Phosphate	0.05	0.06	0.04	<0.05	6	-	mg/l	Photometric
As	<0.003	<0.001	<0.003	<0.003	0.05	0.01	mg/l	Atomic Absorption Spectrophotometer
Fe	0.5	<0.1	0.1	<0.5	0.3-1.0	-	mg/l	Spectrophotometer
Mn	<0.1	<0.1	<0.1	<0.1	0.1	0.5	mg/l	Atomic Absorption Spectrophotometer
Total Coliform	0	0	0	0	0	0	n/100 ml	Membrane Filter Technique
Fecal Coliform	0	0	0	0	0	0	n/100 ml	Membrane Filter Technique

* DoE Standard for drinking water.

Comment: From the above analysis result it is discernible that, all the parameters conform to the given standards.

Md. Faisal Bin Mahmud
Sr. Chemist

Md. Saiful Islam
General Manager

2/12, Humayun Road (2nd Floor), Block-B, Mohammadpur, Dhaka-1207 Tel : +88-02-9116742-13
Mob: 01733376609-10, Fax: +88-02-9116714, Email: nukhan05@gmail.com, aecldhaka@gmail.com

www.aecl-bd.org



Adroit Environment Consultants Ltd.

A House of Complete Environmental Management Solutions

AECL LABORATORY ANALYSIS REPORT **SURFACE WATER QUALITY TEST REPORT**

Memo # AECL : 781
Project Name : Ashuganj 400MW Combined Cycle Power Plant (East)
Project Location : Ashuganj, Brahmanbaria.

Sample Collector : Adroit Environment Consultants Ltd (Monitoring team)
Description of Sample : River Water
Sample Location : Ashuganj, Brahmanbaria (Near project area)
Sampling date : 16th ~ 18th August, 2020
Reporting date : 27th August, 2020

Description of analysis

Name of the Parameter	Concentration present			DoE (Bangladesh) Standard *	Unit	Method of analysis
	Upstream	Downstream	Outfall			
Temperature	26.1	25.9	21.1	40	°C	Mercury filled thermometer
Dissolved Oxygen (DO)	5.8	5.8	6.1	4.5-8	mg/l	DO meter
BOD ₅	0.2	0.1	0.6	50	mg/l	5-day BOD test
COD	2.0	2.0	4.4	200	mg/l	Open Reflux
Chromium	<0.02	<0.02	<0.02	0.5	mg/l	Atomic Absorption Spectrophotometer
Cadmium	<0.002	<0.002	<0.002	0.5	mg/l	Atomic Absorption Spectrophotometer
Pb	<0.05	<0.05	<0.05	0.1	mg/l	Atomic Absorption Spectrophotometer
Oil & Grease	<1.0	0.8	1.6	10	mg/l	APHA 5520.B

*DoE Standard for Inland Surface Water (No standard was found for River Water)

Comment: From the above analysis result it is found that, all the parameters are within allowable limit.

Md. Faisal Bin Mahmud
Sr. Chemist

Md. Saiful Islam
General Manager

2/12, Humayun Road (2nd Floor), Block-B, Mohammadpur, Dhaka-1207 Tel : +88-02-9116712-13
Mob: 01733376609-10, Fax: +88-02-9116714, Email: nukhan05@gmail.com, aecldhaka@gmail.com

www.aecl-bd.org



Adroit Environment Consultants Ltd.

A House of Complete Environmental Management Solutions

AECL LABORATORY ANALYSIS REPORT SOIL QUALITY TEST REPORT

Memo # AECL : 781
Project Name : Ashuganj 400MW Combined Cycle Power Plant (East)
Project Location : Ashuganj, Brahmanbaria.

Sample Collector : Adroit Environment Consultants Ltd (Monitoring team)
Description of Sample : Soil
Sampling Location : Ashuganj, Brahmanbaria (Near project area)
Sampling date : 16th ~ 18th August, 2020
Reporting date : 27th August, 2020

Description of analysis

Name of the Parameter	Concentration present			Unit	Method of analysis
	Location 1 N- 24°2'41.82" E-91°1' 3.83"	Location 2 N- 24°2'40.27" E-91°1' 6.05"	Location 3 N- 24°2'39.72" E-91°1' 8.25"		
Chromium	21.11	17.32	15.18	ppm	Atomic Absorption Spectrophotometer
Cadmium	<1.0	0.5	0.6	ppm	Atomic Absorption Spectrophotometer
Lead	8.81	8.54	18.31	ppm	Atomic Absorption Spectrophotometer
Oil & Grease	1.3	1.6	1.1	mg/kg	APHA 5520.B

*** No standard was found for Soil

Md. Faisal Bin Mahmud
Sr. Chemist

Md. Saiful Islam
General Manager

2/12, Humayun Road (2nd Floor), Block-B, Mohammadpur, Dhaka-1207 Tel : +88-02-9116712-13
Mob: 01733376609-10, Fax: +88-02-9116714, Email: nukhan05@gmail.com, aecldhaka@gmail.com

www.aecl-bd.org





Adroit Environment Consultants Ltd.

A House of Complete Environmental Management Solutions

AECL LABORATORY ANALYSIS REPORT **AMBIENT AIR QUALITY TEST REPORT**

Memorandum No. AEQW : **787**
Project Name : **Ashuganj 400MW CCPP (East)**
Project Location : **Ashuganj, Brahmanbaria.**

Description of Sample : Ambient Air
Sample Collector : Adroit Environment Consultants Ltd. (Monitoring team).
Sampling date : **12th September ~ 14th September, 2020**
Reporting date : **27th September, 2020**

Description of analysis

S N	Paramet ers	Method	Test Duration (hours)	Unit	24°2'3	24°2'3	24°2'3	24°2'58	24°2'31	Bangladesh (DoE) Standard	IFC /World Bank Standard
					8.5" N 91°1' 0.0"E (L1)	0.5" N 91°0'4 2.2"E (L2)	4.7" N 91°1'8. 7"E (L3)	.5" N 91°1'23 .9"E (L4)	.7" N 91°00'3 0.3"E (L5)		
1	PM _{2.5}	Gravimetric	24	µg/m ³	28.2	21.44	41.36	28.55	33.91	65	75
2	PM ₁₀	Gravimetric	24	µg/m ³	101.62	97.74	118.32	90.27	103.56	150	150
3	SPM	Gravimetric	8	µg/m ³	133.20	116.25	159.55	112.94	140.73	200	NF
4	SO ₂	West-Geake	24	µg/m ³	8.12	14.51	11.76	16.31	10.07	365	125
5	NO _x	Jacob and Hochheiser	24	µg/m ³	12.22	16.16	20.01	20.84	18.66	100	200
6	CO	CO/O ₃ Meter	1	ppm	8	0	0	0	0	35	NF

(NF - not found, DoE - Department of Environment.), *1-hour standard Not Found

Note: This monitoring report was usually accomplished by - Respirable Dust Sampler (Model-Envirotech India APM-460BL) and Fine Particulate Sampler (Model- Envirotech India AAS-127BL).

1. Fine Particulate Matter (PM_{2.5}).
2. Respirable Dust Content (PM₁₀).
3. Suspended Particulate Matter (SPM).
4. Oxides of Nitrogen (NO_x).
5. Oxides of Sulfur (SO₂).
6. Carbone Mono-Oxide (CO).

Comment: From the aforementioned results it is discernible that, all the parameters are inside the allowable limits.

Md. Faisal Bin Mahmud
Sr. Chemist

Md. Saiful Islam
General Manager

2/12, Humayun Road (2nd Floor), Block-B, Mohammadpur, Dhaka-1207 Tel : +88-02-9116712-13
 Mob: 01733376609-10, Fax: +88-02-9116714, Email: nukhan05@gmail.com, aeclhdhaka@gmail.com

www.aecl-bd.org



Adroit Environment Consultants Ltd.

A House of Complete Environmental Management Solutions



AECL LABORATORY ANALYSIS REPORT AMBIENT NOISE QUALITY TEST REPORT

Memo # AECL : **787**
Project Name : **Ashuganj 400MW CAPP (East)**
Project Location : **Ashuganj, Brahmanbaria**

Description of Sample : Ambient Noise
Sample Collector : Adroit Environment Consultants Ltd. (Monitoring team)
Sampling date : **12th September ~ 14th September, 2020**
Reporting date : **27th September, 2020**

Description of analysis

SN.	Site Location	Site Condition	Concentrations present (LA _{eq}) dBA.			
			Day Time		Night Time	
			Minimum	Maximum	Minimum	Maximum
01	Test Result in South-West side of Project area near APSCl Admin building, (location #01) N- 24°02'38.5" E-091°01' 0.0"	Construction Stage	49.1	60.3	48.2	53.2
02	Test Result in South-West side of Project area near PDB High School, (location # 02) N-24°02'30.5" E-091°0'42.2"	Construction Stage	58.2	64.4	49.1	51.6
03	Test Result in South-East side of Project area near TSK, (location # 03) N- 24°02'34.7" E-091°01'8.7"	Construction Stage	48.1	62.2	44.1	55.2
04	Test Result in North-East side of Project area near APSCl dormitory, (location #04) N- 24°02'58.5" E-091°01'23.9"	Construction Stage	58.7	60.9	44.4	53.1
05	Test Result in South-West side of Project area near Haji Abdul Jalil High School, (location #05) N- 24°02'31.7" E-091°00'30.3"	Construction Stage	42.2	52.3	43.1	49.4
DoE (Bangladesh) Standard for Industrial area			75		70	
IFC/International Standard for Industrial/Commercial Zone			70		70	

All units are in (LA_{eq}) dBA.

Note: This noise data was usually accomplished by - CEM Sound Level Meter (Model - DT 8850)

Comment: According to the Department of Environment (ECR'1997), the standard for ambient noise level in the industrial zone is 75 and 70 decibels at day & night time respectively. The results were found within the limit as per DoE Standards.

Md. Faisal Bin Mahmud
Sr. Chemist

Md. Saiful Islam
General Manager

2/12, Humayun Road (2nd Floor), Block-B, Mohammadpur, Dhaka-1207 Tel : +88-02-9116712-13
Mob: 01733376609-10, Fax: +88-02-9116714, Email: nukhan05@gmail.com, aecldhaka@gmail.com

www.aecl-bd.org



Adroit Environment Consultants Ltd.

A House of Complete Environmental Management Solutions



AECL LABORATORY ANALYSIS REPORT SURFACE WATER QUALITY TEST REPORT

Memo # AECL : 787
Project Name : Ashuganj 400MW Combined Cycle Power Plant (East)
Project Location : Ashuganj, Brahmanbaria.

Sample Collector : Adroit Environment Consultants Ltd (Monitoring team)
Description of Sample : River Water
Sample Location : Ashuganj, Brahmanbaria (Near project area)
Sampling date : 14th September, 2020
Reporting date : 27th September, 2020

Description of analysis

Name of the Parameter	Concentration present			DoE (Bangladesh) Standard *	Unit	Method of analysis
	Upstream	Downstream	Outfall			
Temperature	25.5	24.7	24.1	40	°C	Mercury filled thermometer
Dissolved Oxygen (DO)	5.5	5.8	5.5	4.5-8	mg/l	DO meter
BOD ₅	0.1	0.3	1.4	50	mg/l	5-day BOD test
COD	0.8	1.0	4.1	200	mg/l	Open Reflux
Chromium	<0.02	<0.02	<0.02	0.5	mg/l	Atomic Absorption Spectrophotometer
Cadmium	<0.002	<0.002	<0.002	0.5	mg/l	Atomic Absorption Spectrophotometer
Pb	<0.05	<0.05	<0.05	0.1	mg/l	Atomic Absorption Spectrophotometer
Oil & Grease	<1.0	<1.0	2.0	10	mg/l	APHA 5520.B

*DoE Standard for Inland Surface Water (No standard was found for River Water)

Comment: From the above analysis result it is found that, all the parameters are within allowable limit.

Md. Faisal Bin Mahmud
Sr. Chemist

Md. Saiful Islam
General Manager

2/12, Humayun Road (2nd Floor), Block-B, Mohammadpur, Dhaka-1207 Tel : +88-02-9116712-13
Mob: 01733376609-10, Fax: +88-02-9116714, Email: nukhan05@gmail.com, aecldhaka@gmail.com

www.aecl-bd.org



Adroit Environment Consultants Ltd.

A House of Complete Environmental Management Solutions



AECL LABORATORY ANALYSIS REPORT DRINKING WATER QUALITY TEST REPORT

Memo # AECL : 787
Project Name : Ashuganj 400MW Combined Cycle Power Plant (East)
Project Location : Ashuganj, Brahmanbaria.

Sample Collector : Adroit Environment Consultants Ltd (Monitoring team).
Description of Sample : Drinking Water
Sample Location : Ashuganj, Brahmanbaria. (Inside project area)
Sampling date : 14th September, 2020
Reporting date : 27th September, 2020

Description of analysis

Name of the Parameter	Concentration Present				DoE (Bangladesh) Standard *	WHO Standard	Unit	Method of analysis
	(D1)	(D2)	(D3)	(D4)				
pH	6.98	7.03	7.03	7.12	6.5 – 8.5	-	-	pH Meter
Ammonia	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	Photometric
Nitrate	<1	<1	<1	<1	10	50	mg/l	Potentiometric
Phosphate	0.05	<0.05	<0.02	<0.05	6	-	mg/l	Photometric
As	<0.005	0.001	<0.005	<0.005	0.05	0.01	mg/l	Atomic Absorption Spectrophotometer
Fe	<0.5	<0.1	<0.1	<0.5	0.3-1.0	-	mg/l	Spectrophotometer
Mn	<0.1	<0.1	<0.1	<0.1	0.1	0.5	mg/l	Atomic Absorption Spectrophotometer
Total Coliform	0	0	0	0	0	0	n/100 ml	Membrane Filter Technique
Fecal Coliform	0	0	0	0	0	0	n/100 ml	Membrane Filter Technique

* DoE Standard for drinking water.

Comment: From the above analysis result it is discernible that, all the parameters conform to the given standards.

Md. Faisal Bin Mahmud
Sr. Chemist

Md. Saiful Islam
General Manager

27/12, Humayun Road (2nd Floor), Block-B, Mohammadpur, Dhaka-1207 Tel : +88-02-9116712-13
Mob: 01733376609-10, Fax: +88-02-9116714, Email: nukhan05@gmail.com, aecldhaka@gmail.com

www.aecl-bd.org



AECL LABORATORY ANALYSIS REPORT AMBIENT AIR QUALITY TEST REPORT

Memo # AECL : **790**
Project Name : **Ashuganj 400MW CCPP (East)**
Project Location : **Ashuganj, Brahmanbaria.**

Description of Sample : Ambient Air
Sample Collector : Adroit Environment Consultants Ltd. (Monitoring team).
Sampling date : **15th ~ 17th October, 2020**
Reporting date : **9th November, 2020**

Description of analysis

S N	Parameters	Method	Test Duration (hours)	Unit	24°2'3	24°2'3	24°2'3	24°2'58	24°2'31	Bangladesh (DoE) Standard	IFC /World Bank Standard
					8.5" N 91° 1' 0.0"E (L1)	0.5" N 91° 0'4 2.2" E (L2)	4.7" N 91° 1'8. 7" E (L3)	.5" N 91°1'23 .9" E (L4)	.7" N 91°00'3 0.3" E (L5)		
1	PM _{2.5}	Gravimetric	24	µg/m ³	22.71	19.37	26.66	22.06	24.43	65	75
2	PM ₁₀	Gravimetric	24	µg/m ³	98.43	90.16	82.01	101.35	96.63	150	150
3	SPM	Gravimetric	8	µg/m ³	126.82	107.32	114.05	120.66	123.98	200	NF
4	SO ₂	West-Geake	24	µg/m ³	12.23	14.72	18.16	13.37	10.11	365	125
5	NO _x	Jacob and Hochheiser	1	µg/m ³	16.72	18.94	27.41	19.22	18.89	NF	200
6	CO	CO/O ₃ Meter	1	ppm	0	0	0	0	2	35	NF

(NF – not found, DoE – Department of Environment.)

Note: This monitoring report was usually accomplished by - Respirable Dust Sampler (Model-Envirotech India APM-460BL) and Fine Particulate Sampler (Model- Envirotech India AAS-127BL).

1. Fine Particulate Matter (PM_{2.5}).
2. Respirable Dust Content (PM₁₀).
3. Suspended Particulate Matter (SPM).
4. Oxides of Nitrogen (NO_x).
5. Oxides of Sulfur (SO₂).
6. Carbone Mono-Oxide (CO).

Comment: From the aforementioned results it is discernible that, all the parameters are inside the allowable limits.

Md. Faisal Bin Mahmud
Sr. Chemist

Md. Saiful Islam
General Manager



AECL LABORATORY ANALYSIS REPORT AMBIENT NOISE QUALITY TEST REPORT

Memo # AECL : 790
Project Name : Ashuganj 400MW CCPP (East)
Project Location : Ashuganj, Brahmanbaria

=====
Description of Sample : Ambient Noise
Sample Collector : Adroit Environment Consultants Ltd. (Monitoring team)
Sampling date : 15th ~ 17th October, 2020
Reporting date : 9th November, 2020
=====

Description of analysis

SN.	Site Location	Site Condition	Concentrations present (LA _{eq}) dBA.			
			Day Time		Night Time	
			Minimum	Maximum	Minimum	Maximum
01	Test Result in South-West side of Project area near APSCS Admin building, (location # 01) N- 24°02'38.5" E-091°01' 0.0"	Construction Stage	53.2	61.3	49.2	52.2
02	Test Result in South-West side of Project area near PDB High School, (location # 02) N-24°02'30.5" E-091°0'42.2"	Construction Stage	53.1	65.1	47.1	57.2
03	Test Result in South-East side of Project area near TSK, (location # 03) N- 24°02'34.7" E-091°01'8.7"	Construction Stage	51.2	57.4	42.1	52.1
04	Test Result in North-East side of Project area near APSCS dormitory, (location # 04) N- 24°02'58.5" E-091°01'23.9"	Construction Stage	60.4	65.9	49.9	57.2
05	Test Result in South-West side of Project area near Haji Abdul Jalil High School, (location # 05) N- 24°02'31.7" E-091°00'30.3"	Construction Stage	52.1	55.4	43.2	47.4
DoE (Bangladesh) Standard for Industrial area			75		70	
IFC/International Standard for Industrial/Commercial Zone			70		70	

Note: This noise data was usually accomplished by – CEM Sound Level Meter (Model – DT 8850)

Comment: According to the Department of Environment (ECR'1997), the standard for ambient noise level in the industrial zone is 75 and 70 decibels at day & night time respectively. The results were found within the limit as per DoE Standards.

Md. Faisal Bin Mahmud
Sr. Chemist

Md. Saiful Islam
General Manager



AECL LABORATORY ANALYSIS REPORT DRINKING WATER QUALITY TEST REPORT

Memorandum #AECL : 790
Project Name : Ashuganj 400MW Combined Cycle Power Plant (East)
Project Location : Ashuganj, Brahmanbaria.
 =====
Sample Collector : Adroit Environment Consultants Ltd (Monitoring team).
Description of Sample : Drinking Water
Sample Location : Ashuganj, Brahmanbaria. (Inside project area)
Sampling date : 17th October, 2020
Reporting date : 9th November, 2020
 =====

Description of analysis

Name of the Parameter	Concentration Present				DoE (Bangladesh) Standard *	WHO Standard	Unit	Method of analysis
	(D1)	(D2)	(D3)	(D4)				
pH	6.82	6.78	6.90	6.93	6.5 – 8.5	-	-	pH Meter
Ammonia	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	Photometric
Nitrate	2.0	<1.0	1.2	<1.0	10	50	mg/l	Potentiometric
Phosphate	0.18	<0.07	<0.07	<0.07	6	-	mg/l	Photometric
As	<0.003	0.003	<0.003	<0.003	0.05	0.01	mg/l	Atomic Absorption Spectrophotometer
Fe	<0.5	0.1	<0.1	<0.5	0.3-1.0	-	mg/l	Spectrophotometer
Mn	<0.1	<0.1	<0.1	<0.1	0.1	0.5	mg/l	Atomic Absorption Spectrophotometer
Total Coliform	0	0	0	0	0	0	n/100 ml	Membrane Filter Technique
Fecal Coliform	0	0	0	0	0	0	n/100 ml	Membrane Filter Technique

* DoE Standard for drinking water.

Comment: From the above analysis result it is discernible that, all the parameters conform to the given standards.

Md. Faisal Bin Mahmud
Sr. Chemist

Md. Saiful Islam
General Manager



AECL LABORATORY ANALYSIS REPORT GROUND WATER QUALITY TEST REPORT



Memo # AECL : 790
Project Name : Ashuganj 400MW Combined Cycle Power Plant (East)
Project Location : Ashuganj, Brahmanbaria.

Sample Collector : Adroit Environment Consultants Ltd. (Monitoring team).
Description of Sample : Ground Water
Sample Location : Ashuganj, Brahmanbaria. (Inside project area)
Sampling date : 17th October, 2020
Reporting date : 9th November, 2020

Description of analysis

Name of the Parameter	Concentration Present				Unit	Method of analysis
	(G1)	(G2)	(G3)	(G4)		
pH	7.02	6.96	7.10	6.96	-	pH Meter
TDS	310	310	327	298	Mg/l	TDS Meter
Ammonia	<0.01	<0.01	<0.01	<0.01	mg/l	Photometric
Nitrate	1.8	<1.0	1.5	<1.0	mg/l	Potentiometric
Phosphate	0.1	<0.07	0.1	<0.07	mg/l	Photometric
As	<0.003	<0.003	<0.003	<0.003	mg/l	Atomic Absorption Spectrophotometer
Fe	0.4	0.1	<0.3	0.7	mg/l	Spectrophotometer
Mn	0.1	<0.1	<0.1	<0.1	mg/l	Atomic Absorption Spectrophotometer
Total Coliform	0	0	0	0	n/100 ml	Membrane Filter Technique
Fecal Coliform	0	0	0	0	n/100 ml	Membrane Filter Technique

* No standard found for ground water

Md. Faisal Bin Mahmud
Sr. Chemist

Md. Saiful Islam
General Manager



AECL LABORATORY ANALYSIS REPORT SURFACE WATER QUALITY TEST REPORT

Memo # AECL : 790
Project Name : Ashuganj 400MW Combined Cycle Power Plant (East)
Project Location : Ashuganj, Brahmanbaria.
 =====
Sample Collector : Adroit Environment Consultants Ltd (Monitoring team)
Description of Sample : River Water
Sample Location : Ashuganj, Brahmanbaria (Near project area)
Sampling date : 17th November, 2020
Reporting date : 9th November, 2020
 =====

Description of analysis

Name of the Parameter	Concentration present			Unit	Method of analysis
	Upstream	Downstream	Outfall		
Temperature	24.6	24.3	24.3	°C	Mercury filled thermometer
Dissolved Oxygen (DO)	5.2	5.6	5.2	mg/l	DO meter
BOD ₅	0.2	0.9	0.3	mg/l	5-day BOD test
COD	0.5	0.5	1.9	mg/l	Open Reflux
Chromium	<0.02	<0.02	<0.02	mg/l	Atomic Absorption Spectrophotometer
Cadmium	<0.002	<0.002	<0.002	mg/l	Atomic Absorption Spectrophotometer
Pb	<0.05	<0.05	<0.05	mg/l	Atomic Absorption Spectrophotometer
Oil & Grease	<5.0	<5.0	<5.0	mg/l	APHA 5520.B

***No standard was found for River Water

Md. Faisal Bin Mahmud
Sr. Chemist

Md. Saiful Islam
General Manager



AECL LABORATORY ANALYSIS REPORT AMBIENT AIR QUALITY TEST REPORT

Memo # **AECL** : **799**
Project Name : **Ashuganj 400MW CCPP (East)**
Project Location : **Ashuganj, Brahmanbaria.**

Description of Sample : Ambient Air
Sample Collector : Adroit Environment Consultants Ltd. (Monitoring team).
Sampling date : **14th November ~ 17th November, 2020**
Reporting date : **21st November, 2020**

Description of analysis

S N	Parameters	Method	Test Duration (hours)	Unit	24°2'3	24°2'3	24°2'3	24°2'58	24°2'31	Bangladesh (DoE) Standard	IFC /World Bank Standard
					8.5" N 91° 1' 0.0"E (L1)	0.5" N 91° 0'4 2.2" E (L2)	4.7" N 91° 1'8. 7" E (L3)	.5" N 91°1'23 .9" E (L4)	.7" N 91°00'3 0.3" E (L5)		
1	PM _{2.5}	Gravimetric	24	µg/m ³	37.73	43.21	39.17	40.16	33.23	65	75
2	PM ₁₀	Gravimetric	24	µg/m ³	73.12	100.23	79.46	93.94	84.16	150	150
3	SPM	Gravimetric	8	µg/m ³	114.18	141.95	116.83	139.19	119.04	200	NF
4	SO ₂	West-Geake	24	µg/m ³	16.62	18.14	14.43	21.17	16.73	365	125
5	NO _x	Jacob and Hochheiser	1	µg/m ³	20.94	28.23	27.46	19.17	19.16	NF	200
6	CO	CO/O ₃ Meter	1	ppm	0	0	0	0	0	35	NF

(NF – not found, DoE – Department of Environment.), *1-hour standard Not Found

Note: This monitoring report was usually accomplished by - Respirable Dust Sampler (Model-Envirotech India APM-460BL) and Fine Particulate Sampler (Model- Envirotech India AAS-127BL).

1. Fine Particulate Matter (PM_{2.5}).
2. Respirable Dust Content (PM₁₀).
3. Suspended Particulate Matter (SPM).
4. Oxides of Nitrogen (NO_x).
5. Oxides of Sulfur (SO₂).
6. Carbone Mono-Oxide (CO).

Comment: From the aforementioned results it is discernible that, all the parameters are inside the allowable limits.

Md. Faisal Bin Mahmud
Sr. Chemist

Md. Saiful Islam
General Manager



AECL LABORATORY ANALYSIS REPORT AMBIENT NOISE QUALITY TEST REPORT

Memo # AECL : 799
Project Name : Ashuganj 400MW CCPP (East)
Project Location : Ashuganj, Brahmanbaria

Description of Sample : Ambient Noise
Sample Collector : Adroit Environment Consultants Ltd. (Monitoring team)
Sampling date : 14th ~ 17th November, 2020
Reporting date : 5th December, 2020

Description of analysis

SN.	Site Location	Site Condition	Concentrations present (LA _{eq}) dBA.			
			Day Time		Night Time	
			Minimum	Maximum	Minimum	Maximum
01	Test Result in South-West side of Project area near APSCCL Admin building, (location # 01) N- 24°02'38.5" E-091°01' 0.0"	Construction Stage	52.2	58.1	46.1	51.1
02	Test Result in South-West side of Project area near PDB High School, (location # 02) N-24°02'30.5" E-091°0'42.2"	Construction Stage	56.4	66.2	47.3	49.9
03	Test Result in South-East side of Project area near TSK, (location # 03) N- 24°02'34.7" E-091°01'8.7"	Construction Stage	48.1	64.5	51.0	53.7
04	Test Result in North-East side of Project area near APSCCL dormitory, (location # 04) N- 24°02'58.5" E-091°01'23.9"	Construction Stage	62.6	66.3	50.4	51.8
05	Test Result in South-West side of Project area near Haji Abdul Jalil High School, (location # 05) N- 24°02'31.7" E-091°00'30.3"	Construction Stage	48.8	57.1	44.2	45.1
DoE (Bangladesh) Standard for Industrial area			75		70	
IFC/International Standard for Industrial/Commercial Zone			70		70	

Note: This noise data was usually accomplished by – CEM Sound Level Meter (Model – DT 8850)

Comment: According to the Department of Environment (ECR'1997), the standard for ambient noise level in the industrial zone is 75 and 70 decibels at day & night time respectively. The results were found within the limit as per DoE Standards.

Md. Faisal Bin Mahmud
Sr. Chemist

Md. Saiful Islam
General Manager

2/12, Humayun Road (2nd Floor), Block-B, Mohammadpur, Dhaka-1207 Tel: +88-02-9116712-13
Mob: 01733376609-10, Fax: +88-02-9116714, Email: nukhan05@gmail.com, aeclbdhaka@gmail.com

WWW.Aecl-bd.org



AECL LABORATORY ANALYSIS REPORT SURFACE WATER QUALITY TEST REPORT

Memo # AECL : 799
Project Name : Ashuganj 400MW Combined Cycle Power Plant (East)
Project Location : Ashuganj, Brahmanbaria.

Sample Collector : Adroit Environment Consultants Ltd (Monitoring team)
Description of Sample : River Water
Sample Location : Ashuganj, Brahmanbaria (Near project area)
Sampling date : 17th November, 2020
Reporting date : 5th December, 2020

Description of analysis

Name of the Parameter	Concentration present			Unit	Method of analysis
	Upstream	Downstream	Outfall		
Temperature	22.6	20.7	20.4	°C	Mercury filled thermometer
Dissolved Oxygen (DO)	5.8	5.4	4.8	mg/l	DO meter
BOD ₅	0.1	0.1	0.6	mg/l	5-day BOD test
COD	1.0	1.0	2.8	mg/l	Open Reflux
Chromium	<0.02	<0.02	<0.02	mg/l	Atomic Absorption Spectrophotometer
Cadmium	<0.002	<0.002	<0.002	mg/l	Atomic Absorption Spectrophotometer
Pb	<0.05	<0.05	<0.05	mg/l	Atomic Absorption Spectrophotometer
Oil & Grease	<5.0	<5.0	<5.0	mg/l	APHA 5520.B

***No standard was found for River Water

Md. Faisal Bin Mahmud
Sr. Chemist

Md. Saiful Islam
General Manager



AECL LABORATORY ANALYSIS REPORT DRINKING WATER QUALITY TEST REPORT

Memorandum #: **799**
Project Name : Ashuganj 400MW Combined Cycle Power Plant (East)
Project Location : Ashuganj, Brahmanbaria.

Sample Collector : Adroit Environment Consultants Ltd (Monitoring team).
Description of Sample : Drinking Water
Sample Location : Ashuganj, Brahmanbaria
Sampling date : 17th November, 2020
Reporting date : 5th December, 2020

Description of analysis

Name of the Parameter	Concentration Present				DoE (Bangladesh) Standard *	WHO Standard	Unit	Method of analysis
	(D1)	(D2)	(D3)	(D4)				
pH	6.79	7.12	6.98	7.12	6.5 – 8.5	-	-	pH Meter
Ammonia	<0.01	<0.01	<0.01	0.01	<0.01	<0.01	<0.01	Photometric
Nitrate	<1	<1	<1	8	10	50	mg/l	Potentiometric
Phosphate	0.07	0.07	0.08	0.3	6	-	mg/l	Photometric
As	0.01	0.003	0.003	0.102	0.05	0.01	mg/l	Atomic Absorption Spectrophotometer
Fe	<0.5	<0.1	<0.1	<0.5	0.3-1.0	-	mg/l	Spectrophotometer
Mn	<0.1	<0.1	<0.1	0.1	0.1	0.5	mg/l	Atomic Absorption Spectrophotometer
Total Coliform	0	0	0	0	0	0	n/100 ml	Membrane Filter Technique
Fecal Coliform	0	0	0	0	0	0	n/100 ml	Membrane Filter Technique

* DoE Standard for drinking water.

Comment: Arsenic (As) content at location D4 i.e. drinking water source of Hazi Abdul Jalil High School doesn't conform to the given limit.

Md. Faisal Bin Mahmud
Sr. Chemist

Md. Saiful Islam
General Manager



AECL LABORATORY ANALYSIS REPORT AMBIENT AIR QUALITY TEST REPORT

Memo # AECL : **805**
Project Name : **Ashuganj 400MW CCPP (East)**
Project Location : **Ashuganj, Brahmanbaria.**

Description of Sample : Ambient Air
Sample Collector : Adroit Environment Consultants Ltd. (Monitoring team).
Sampling date : **12th ~ 15th December, 2020**
Reporting date : **20th December, 2020**

Description of analysis

S N	Parameters	Method	Test Duration (hours)	Unit	24°2'3	24°2'3	24°2'3	24°2'58.	24°2'31.	Bangladesh (DoE) Standard	IFC /World Bank Standard
					8.5" N 91°1' 0.0"E (L1)	0.5" N 91°0'4 2.2" E (L2)	4.7" N 91°1'8 .7" E (L3)	5" N 91°1'23. 9" E (L4)	7" N 91°00'3 0.3" E (L5)		
1	PM _{2.5}	Gravimetric	24	µg/m ³	25.59	42.23	43.72	48.81	44.29	65	75
2	PM ₁₀	Gravimetric	24	µg/m ³	138.73	107.17	91.24	99.73	128.15	150	150
3	SPM	Gravimetric	8	µg/m ³	157.34	149.10	136.56	150.86	179.27	200	NF
4	SO ₂	West-Geake	24	µg/m ³	9.21	6.62	10.77	9.61	14.44	365	125
5	NO _x	Jacob and Hochheiser	1	µg/m ³	16.98	18.17	18.20	19.92	19.61	NF	200
6	CO	CO/O ₃ Meter	1	ppm	3	0	2	0	2	35	NF

(NF – not found, DoE – Department of Environment.), *1-hour standard Not Found

Note: This monitoring report was usually accomplished by - Respirable Dust Sampler (Model-Envirotech India APM-460BL) and Fine Particulate Sampler (Model- Envirotech India AAS-127BL).

- | | |
|--|---|
| 1. Fine Particulate Matter (PM _{2.5}). | 4. Oxides of Nitrogen (NO _x). |
| 2. Respirable Dust Content (PM ₁₀). | 5. Oxides of Sulfur (SO ₂). |
| 3. Suspended Particulate Matter (SPM). | 6. Carbone Mono-Oxide (CO). |

Comment: From the aforementioned results it is discernible that, all the parameters are inside the allowable limits.

Md. Faisal Bin Mahmud
Sr. Chemist

Md. Saiful Islam
General Manager



AECL LABORATORY ANALYSIS REPORT AMBIENT NOISE QUALITY TEST REPORT

Memo # AECL : **805**
Project Name : **Ashuganj 400MW CCPP (East)**
Project Location : **Ashuganj, Brahmanbaria**

Description of Sample : Ambient Noise
Sample Collector : Adroit Environment Consultants Ltd. (Monitoring team)
Sampling date : **12th ~ 15th December, 2020**
Reporting date : **20th December, 2020**

Description of analysis

SN.	Site Location	Site Condition	Concentrations present (LA _{eq}) dBA.			
			Day Time		Night Time	
			Minimum	Maximum	Minimum	Maximum
01	Test Result in South-West side of Project area near APSCl Admin building, (location # 01) N- 24°02'38.5" E-091°01' 0.0"	Construction Stage	56.6	61.6	47.8	54.3
02	Test Result in South-West side of Project area near PDB High School, (location # 02) N-24°02'30.5" E-091°0'42.2"	Construction Stage	51.1	65.1	46.1	52.8
03	Test Result in South-East side of Project area near TSK, (location # 03) N- 24°02'34.7" E-091°01'8.7"	Construction Stage	54.7	62.8	49.9	58.3
04	Test Result in North-East side of Project area near APSCl dormitory, (location # 04) N- 24°02'58.5" E-091°01'23.9"	Construction Stage	57.9	64.4	52.1	57.4
05	Test Result in South-West side of Project area near Haji Abdul Jalil High School, (location # 05) N- 24°02'31.7" E-091°00'30.3"	Construction Stage	49.1	59.1	48.4	56.4
DoE (Bangladesh) Standard for Industrial area			75		70	
IFC/International Standard for Industrial/Commercial Zone			70		70	

Note: This noise data was usually accomplished by – CEM Sound Level Meter (Model – DT 8850)

Comment: According to the Department of Environment (ECR'1997), the standard for ambient noise level in the industrial zone is 75 and 70 decibels at day & night time respectively. The results were found within the limit as per DoE Standards.

Md. Faisal Bin Mahmud
Sr. Chemist

Md. Saiful Islam
General Manager



AECL LABORATORY ANALYSIS REPORT DRINKING WATER QUALITY TEST REPORT

Memo # AECL : 805
Project Name : Ashuganj 400MW Combined Cycle Power Plant (East)
Project Location : Ashuganj, Brahmanbaria.

Sample Collector : Adroit Environment Consultants Ltd (Monitoring team).
Description of Sample : Drinking Water
Sample Location : Ashuganj, Brahmanbaria
Sampling date : 14th December, 2020
Reporting date : 24th December, 2020

Description of analysis

Name of the Parameter	Concentration Present				DoE (Bangladesh) Standard *	WHO Standard	Unit	Method of analysis
	(D1)	(D2)	(D3)	(D4)				
pH	6.84	6.98	6.93	7.22	6.5 – 8.5	-	-	pH Meter
Ammonia	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	Photometric
Nitrate	<1	<1	<1	2	10	50	mg/l	Potentiometric
Phosphate	0.08	<0.07	0.08	0.1	6	-	mg/l	Photometric
As	<0.003	0.005	0.004	0.008	0.05	0.01	mg/l	Atomic Absorption Spectrophotometer
Fe	0.53	0.45	0.83	1.76	0.3-1.0	-	mg/l	Spectrophotometer
Mn	<0.1	<0.1	<0.1	0.1	0.1	0.5	mg/l	Atomic Absorption Spectrophotometer
Total Coliform	0	0	0	0	0	0	n/100 ml	Membrane Filter Technique
Fecal Coliform	0	0	0	0	0	0	n/100 ml	Membrane Filter Technique

* DoE Standard for drinking water.

Comment: Iron (Fe) content at location D4 i.e. drinking water source of Hazi Abdul Jalil High School doesn't conform to the given limit.

Md. Faisal Bin Mahmud
Sr. Chemist

Md. Saiful Islam
General Manager



AECL LABORATORY ANALYSIS REPORT SURFACE WATER QUALITY TEST REPORT

Memo # AECL : 805
Project Name : Ashuganj 400MW Combined Cycle Power Plant (East)
Project Location : Ashuganj, Brahmanbaria.

Sample Collector : Adroit Environment Consultants Ltd (Monitoring team)
Description of Sample : River Water
Sample Location : Ashuganj, Brahmanbaria (Near project area)
Sampling date : 15th December, 2020
Reporting date : 24th December, 2020

Description of analysis

Name of the Parameter	Concentration present			Unit	Method of analysis
	Upstream	Downstream	Outfall		
Temperature	21.4	21.2	18.6	°C	Mercury filled thermometer
Dissolved Oxygen (DO)	5.6	5.2	5.0	mg/l	DO meter
BOD ₅	0.2	0.6	1.0	mg/l	5-day BOD test
COD				mg/l	Open Reflux
Chromium	0.04	0.02	<0.02	mg/l	Atomic Absorption Spectrophotometer
Cadmium	<0.002	<0.002	<0.002	mg/l	Atomic Absorption Spectrophotometer
Pb	<0.05	<0.05	<0.05	mg/l	Atomic Absorption Spectrophotometer
Oil & Grease				mg/l	APHA 5520.B

***No standard was found for River Water

Md. Faisal Bin Mahmud
Sr. Chemist

Md. Saiful Islam
General Manager

Government of the People's Republic of Bangladesh

Department of Environment

Head Office, Paribesh Bhaban

E-16 Agargaon, Dhaka-1207

www.doe.gov.bd

Memo No : DoE/Clearance/5484/2015/491

Date: 08/10/2015

Subject: Approval of Environmental Impact Assessment (EIA) Report for Ashuganj 400 MW Combined Cycle Power Plant (East) at Ashuganj under Brahmanbaria District.

Ref: Your Application dated 06/08/2015.

With reference to the above, the Department of Environment (DOE) is pleased to approve Environmental Impact Assessment (EIA) Report for Ashuganj 400 MW Combined Cycle Power Plant (East) at Ashuganj under Brahmanbaria District subject to fulfilling the following terms and conditions.

1. This EIA report is approved only for 400 MW Combined Cycle power plant. Any expansion or extension of this power plant will be required further/fresh EIA study for the Environmental clearance from the Department of Environment (DOE).
2. Project Proponent may undertake activities for land development and infrastructural development of the project.
3. Project Proponent may open L/C (Letter of Credit) for importing machineries for the project which shall also include machineries relating to waste treatment plant and other pollution control devices.
4. The activity under the Power Plant Construction Project shall not result in the loss of containment of any materials that would affect health or will have damaging impact on the environment or natural resources.
5. Proper and adequate mitigation measures shall be ensured throughout preparation, construction and operation period of the proposed Power Plant Construction Project activities.
6. Any heritage sight, ecological critical area, and other environmentally and/or religious sensitive places shall be avoided during project construction phase.
7. Proper construction and development practices shall be followed that minimize loss of habitats and fish breeding, feeding & nursery sites.
8. Construction works shall be restricted to day time hours so as to avoid/mitigate the disturbance of local lives as well as implementation schedules of the works shall be notified in advance to nearby residents.
9. Proper and adequate sanitation facilities shall be ensured in labor camps throughout the proposed project period.




1/3

10. In order to control noise pollution, vehicles & equipment shall be maintained regularly; working during sensitive hours and locating machinery close to sensitive receptor shall be avoided.
11. No solid waste can be burnt in the project area. An environment friendly solid waste management should be in place during the whole period of the project in the field.
12. Proper and adequate on-site precautionary measures and safety measures shall be ensured so that no habitat of any flora and fauna would be demolished or destroyed.
13. All the required mitigation measures suggested in the EIA report along with the emergency response plan are to be strictly implemented and kept operative/functioning on a continuous basis.
14. To reduce dust, spraying of water over the earthen materials should be carried out from time to time.
15. Storage area for soils and other construction materials shall be carefully selected to avoid disturbance of the natural drainage.
16. Adequate considerations should be given to facilitate drainage system for run off water from rain.
17. Adequate facilities should be ensured for silt trap to avoid clogging of drain/canal/water bodies.
18. Construction material should be properly disposed off after the construction work is over.
19. The project authority shall submit a detail work plan with time schedule of development activities at least 7 (seven) days ahead of the work commences in the field to the Brahmanbaria District Office, Chittagong Regional Office and Headquarters of the Department of Environment simultaneously.
20. Environmental Monitoring Reports shall be made available simultaneously to DOE Brahmanbaria District Office, Chittagong Regional Office and Headquarters on a monthly basis during the construction period of the project.
21. The following records must be kept in respect of any samples required to be collected for the purposes of environmental monitoring activities :
 - (a) the date(s) on which the sample was taken;
 - (b) the time(s) at which the sample was collected;
 - (c) the point at which the sample was taken; and
 - (d) the name of the person who collected the sample.
22. The results of any monitoring required to be conducted under this EIA report must be recorded.
23. In case of any emergency, the following information shall immediately be reported to Brahmanbaria District Office, Chittagong Regional office and Headquarters of the Department of Environment (DOE) simultaneously
 - a) Nature of incident (land slides, fire, accident, collision, etc.)
 - b) Personnel affected (injured, missing, fatalities, etc.)
 - c) Emergency support available and its location (standby transport, medical facilities, etc.)
 - d) Weather conditions



2/3

- e) Current operations (abandoning the site, fire fighting, etc.)
24. Appropriate permission would require to be obtained from the Forest Department in favor of cutting/felling of any plant/tree/sapling forested by any individual or government before doing such type of activity.
 25. The project authority shall extend active cooperation to DOE officials to facilitate their visit to the site as and when necessary.
 26. The project authority shall, after land development, infrastructural development and installation of the power plant, apply for Environmental Clearance to the Brahmanbaria District Office of DOE with a copy to the Head Office of DOE in Dhaka.
 27. Without obtaining Environmental Clearance, the project authority shall not start the operation of the project.
 28. Violation of any of the above conditions shall render this approval void.
 29. The project authority shall, after land development, infrastructural development and installation of the plant, apply for Environmental Clearance Certificate without which proponent shall not start operation of the project.
 30. This EIA Approval has been issued with the approval of the appropriate authority.



08.10.2015

(Syed Nazmul Ahsan)
Director (Environmental Clearance)
Phone # 02-8181778

Managing Director
Ashuganj 400 MW Combined
Cycle Power Plant (East)
Sunarampur, Ashuganj
Brahmanbaria.

Copy Forwarded to :

- 1) PS to Secretary, Ministry of Environment and Forests, Bangladesh Secretariat, Dhaka.
- 2) Director, Department of Environment, Chittagong Divisional Office, Chittagong.
- 3) Deputy Director/Office In-charge, Department of Environment, Brahmanbaria District Office, Brahmanbaria.
- 4) Assistant Director, Office of the Director General, Department of Environment, Head Office, Dhaka.


03.01.2021
Md. Atiqur Rahman
Manager (Health, Safety & Environment)
Ashuganj Power Station Co. Ltd.
Ashuganj, Brahmanbaria