

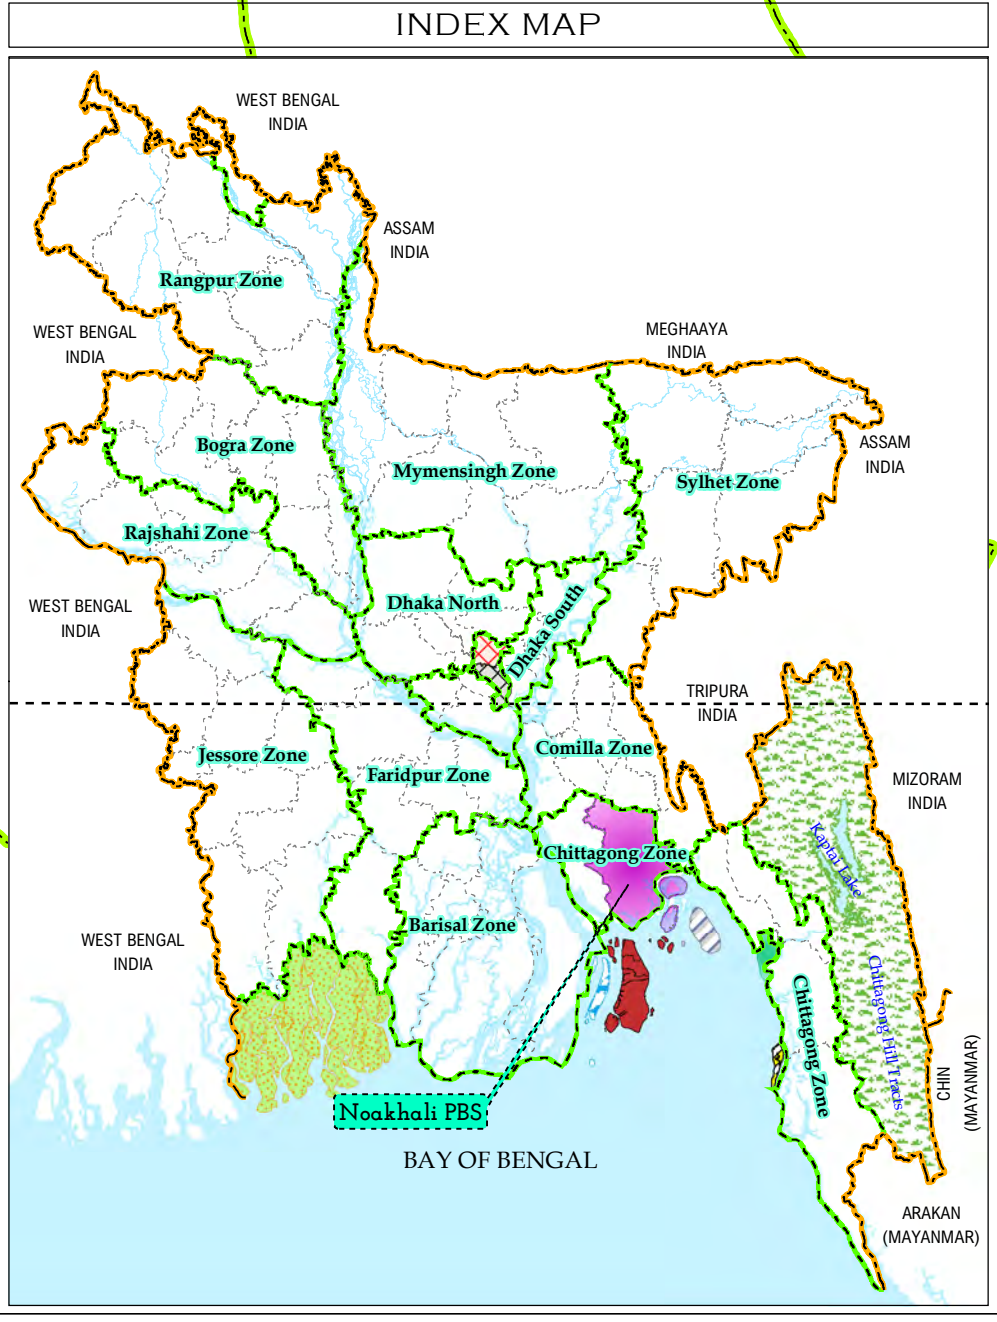


GIS MAP OF 33 KV SOURCE LINE OF NOAKHALI PBS

1:90,000

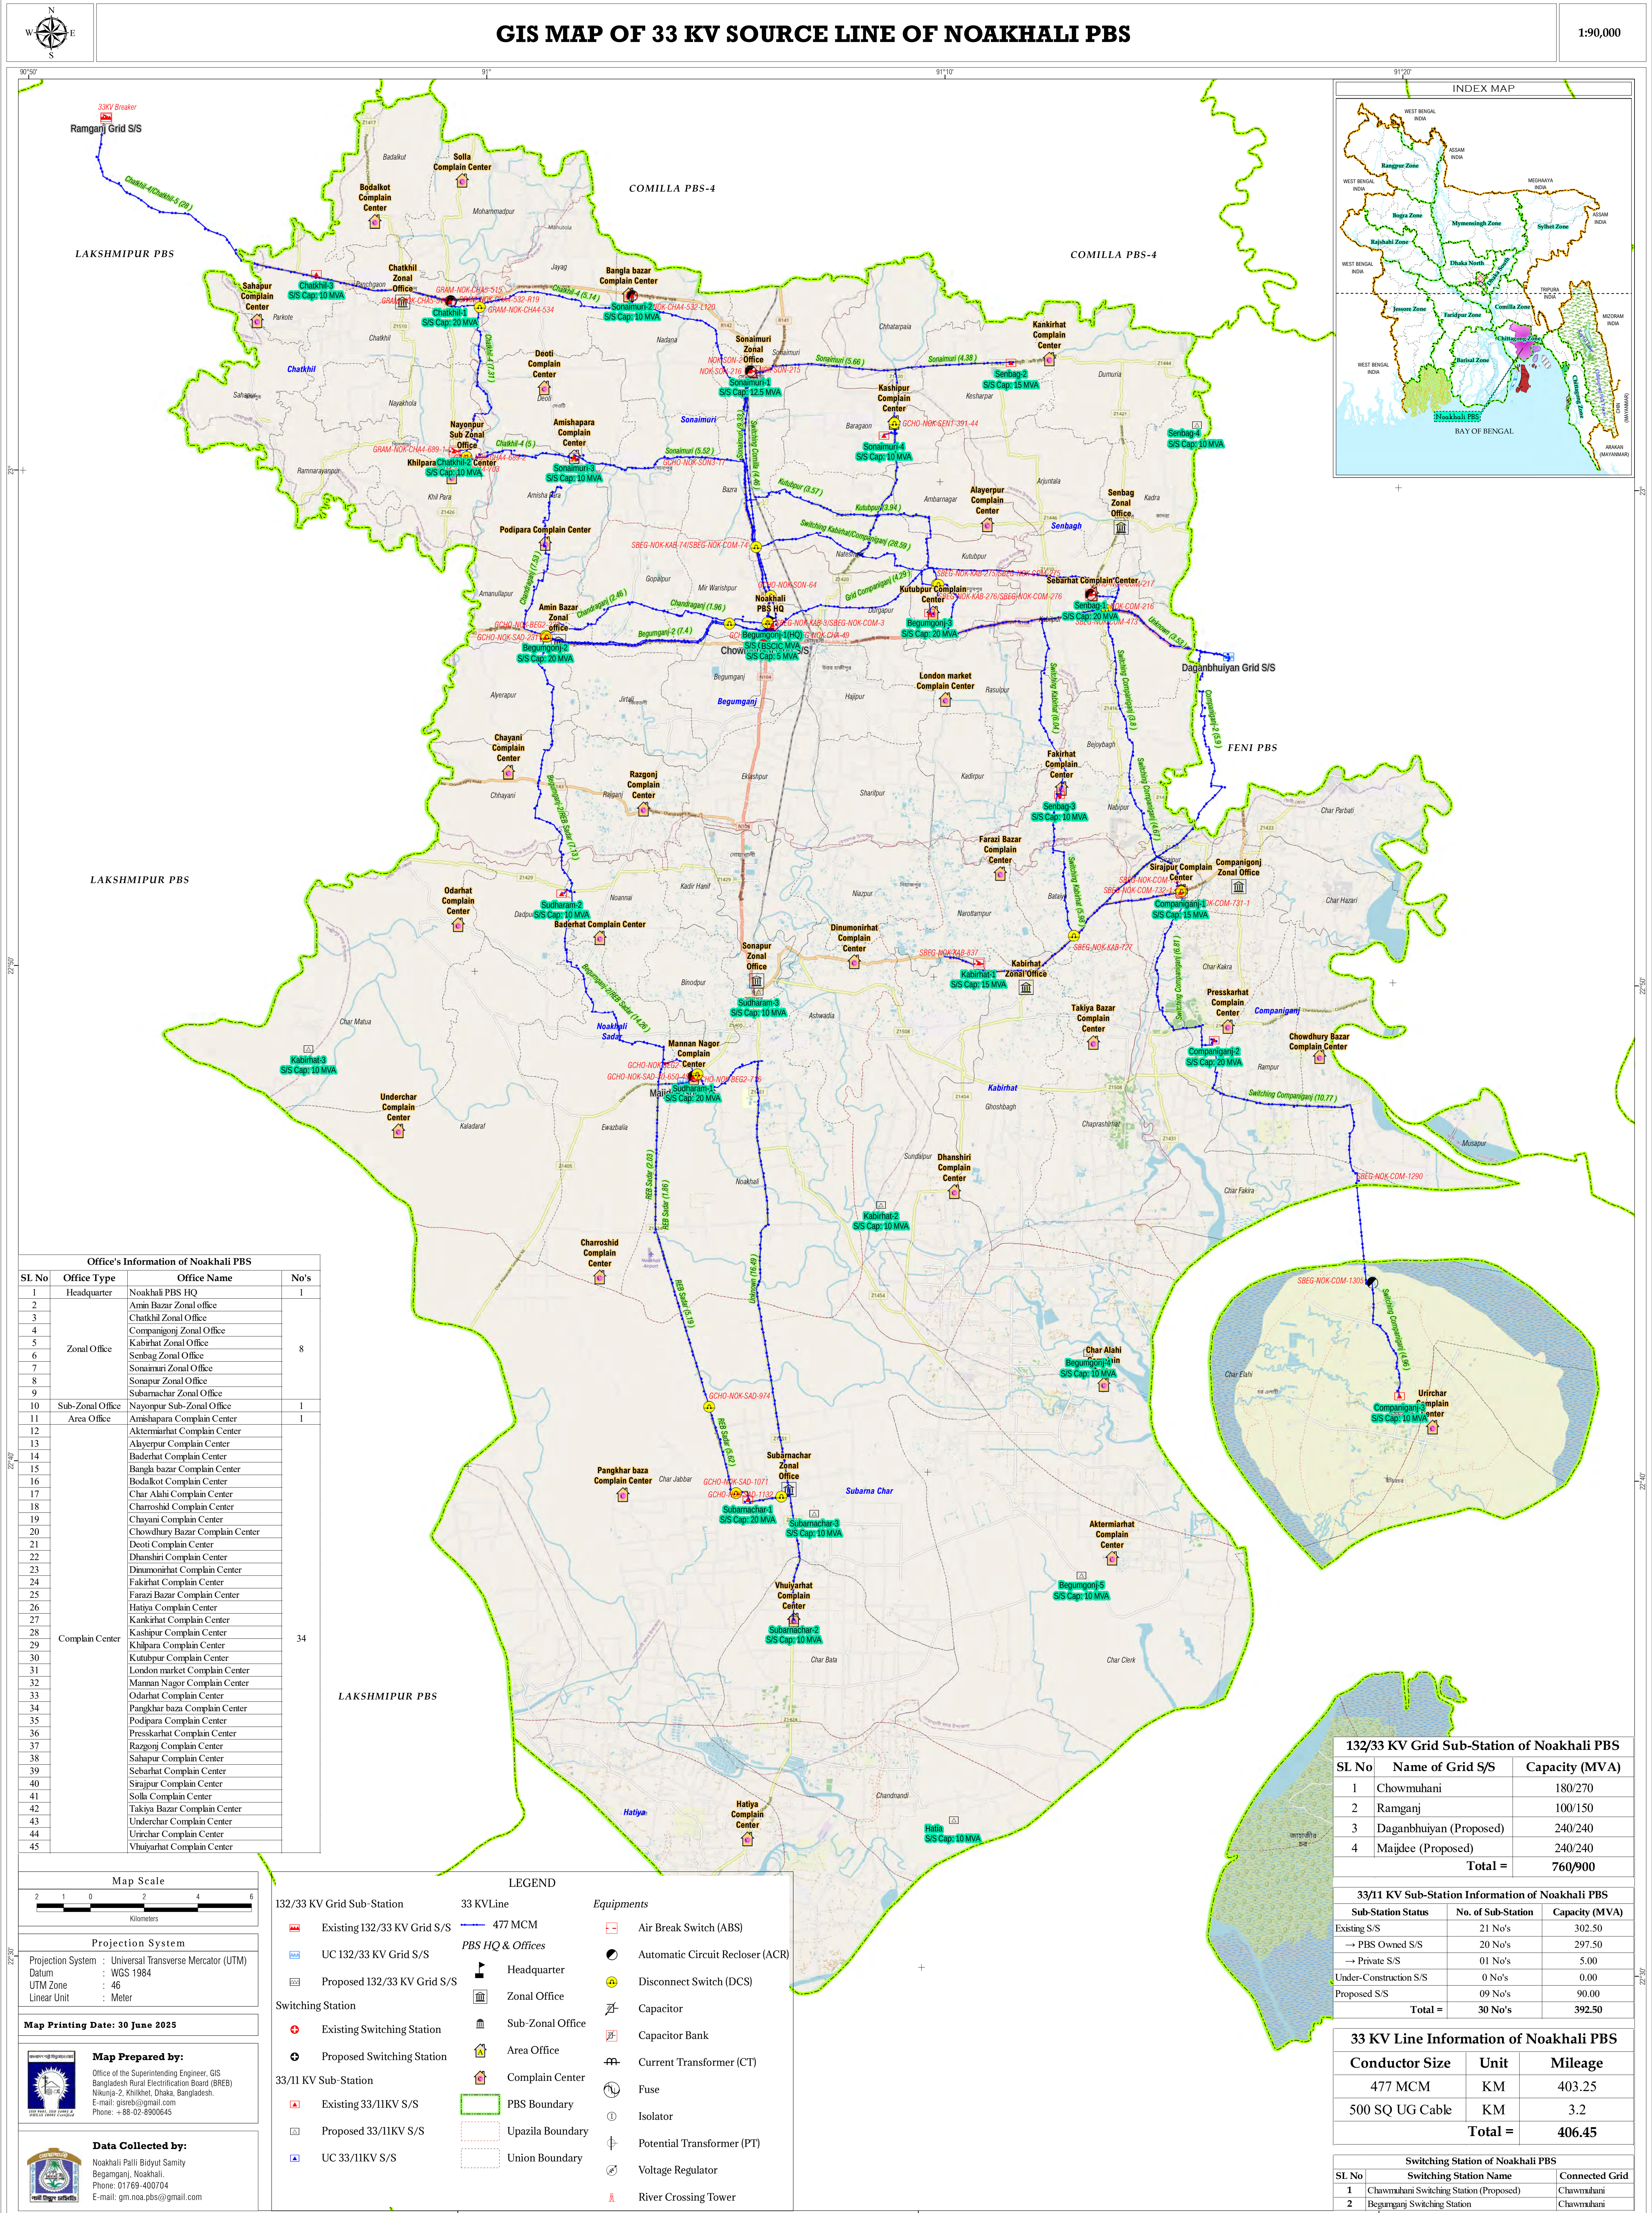

Office's Information of Noakhali PBS			
SL No	Office Type	Office Name	No's
1	Headquarter	Noakhali PBS HQ	1
2	Zonal Office	Amin Bazar Zonal Office	8
3		Chatkhil Zonal Office	
4		Companiganj Zonal Office	
5		Kabirhat Zonal Office	
6		Senbag Zonal Office	
7		Sonaimuri Zonal Office	
8		Sonapur Zonal Office	
9		Subarnachar Zonal Office	
10	Sub-Zonal Office	Nayonpur Sub-Zonal Office	1
11	Area Office	Amishapara Complain Center	34
12		Aktermarhat Complain Center	
13		Alyerpur Complain Center	
14		Baderhat Complain Center	
15		Bangla bazar Complain Center	
16		Bodakot Complain Center	
17		Char Alahi Complain Center	
18		Charoshid Complain Center	
19		Chayani Complain Center	
20		Chowdhury Bazar Complain Center	
21		Deoti Complain Center	
22		Dhanshiri Complain Center	
23		Dinamonirhat Complain Center	
24		Fakirhat Complain Center	
25		Farazi Bazar Complain Center	
26		Hatiya Complain Center	
27		Kankirhat Complain Center	
28		Kashipur Complain Center	
29		Khilpara Complain Center	
30		Kutubpur Complain Center	
31		London market Complain Center	
32		Mannan Nagar Complain Center	
33		Odahat Complain Center	
34		Pangkhar baza Complain Center	
35		Podipara Complain Center	
36		Presskarhat Complain Center	
37		Razgonj Complain Center	
38		Sahapur Complain Center	
39		Sebarhat Complain Center	
40		Sirajpur Complain Center	
41		Solla Complain Center	
42		Takiya Bazar Complain Center	
43		Underchar Complain Center	
44		Urirchar Complain Center	
45		Vhuyarhat Complain Center	

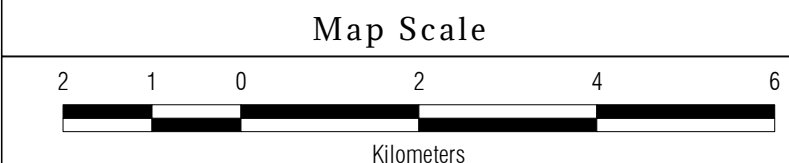

Projection System : Universal Transverse Mercator (UTM)
Datum : WGS 1984
UTM Zone : 46
Linear Unit : Meter

Map Printing Date: 30 June 2025

Map Prepared by:
Office of the Superintending Engineer, GIS
Bangladesh Rural Electrification Board (BREB)
Nikunja-2, Khilket, Dhaka, Bangladesh.
E-mail: gisnbs@gmail.com
Phone: +88-02-8900645

Data Collected by:
Noakhali Palli Bidyut Samity
Begumganj, Noakhali.
Phone: 01769-400704
E-mail: gm.noa.pbs@gmail.com

LEGEND

132/33 KV Grid Sub-Station

- Existing 132/33 KV Grid S/S
- UC 132/33 KV Grid S/S
- Proposed 132/33 KV Grid S/S

Switching Station

- Existing Switching Station
- Proposed Switching Station

33/11 KV Sub-Station

- Existing 33/11KV S/S
- Proposed 33/11KV S/S
- UC 33/11KV S/S

33 KVLine

- 477 MCM

PBS HQ & Offices

- Headquarter
- Zonal Office
- Sub-Zonal Office
- Area Office
- Complain Center

Equipments

- Air Break Switch (ABS)
- Automatic Circuit Recloser (ACR)
- Disconnect Switch (DCS)
- Capacitor
- Capacitor Bank
- Current Transformer (CT)
- Fuse
- Isolator
- Potential Transformer (PT)
- Voltage Regulator
- River Crossing Tower

Other Symbols:

- Headquarter
- Zonal Office
- Sub-Zonal Office
- Area Office
- Complain Center
- PBS Boundary
- Upazila Boundary
- Union Boundary

132/33 KV Grid Sub-Station of Noakhali PBS		
SL No	Name of Grid S/S	Capacity (MVA)
1	Chowmuhani	180/270
2	Ramganj	100/150
3	Daganbhuiyan (Proposed)	240/240
4	Maijdee (Proposed)	240/240
Total =		760/900

33/11 KV Sub-Station Information of Noakhali PBS		
Sub-Station Status	No. of Sub-Station	Capacity (MVA)
Existing S/S	21 No's	302.50
→ PBS Owned S/S	20 No's	297.50
→ Private S/S	01 No's	5.00
Under-Construction S/S	0 No's	0.00
Proposed S/S	09 No's	90.00
Total =		30 No's 392.50

33 KV Line Information of Noakhali PBS		
Conductor Size	Unit	Mileage
477 MCM	KM	403.25
500 SQ UG Cable	KM	3.2
Total =		406.45

Switching Station of Noakhali PBS		
SL No	Switching Station Name	Connected Grid
1	Chowmuhani Switching Station (Proposed)	Chowmuhani
2	Begumganj Switching Station	Chowmuhani