



GIS MAP OF 33 KV SOURCE LINE OF PABNA PBS-2

1:70,000

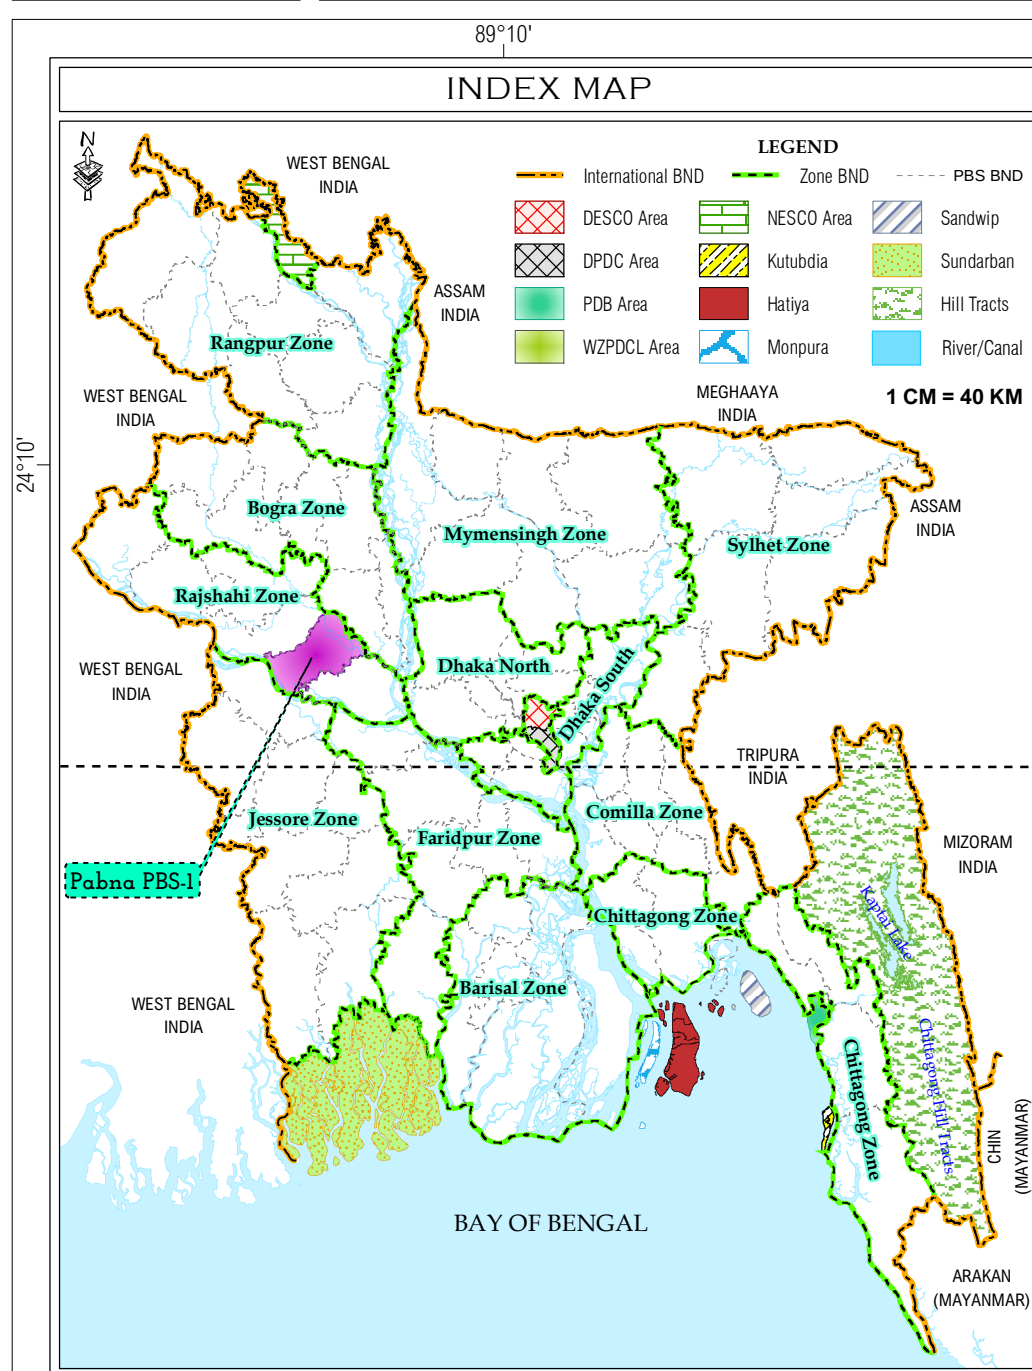


Office's Information of Pabna PBS-2			
SL.No	Office Type	Office Name	No's
1	Headquarter	Pabna PBS-2 HQ	1
2	Zonal Office	Ataikula Zonal Office	3
3		Bera Zonal Office	
4		Sujanagar Zonal Office	
	Sub-Zonal Office	Badherhat Sub Zonal Office	3
7		Santhia Sub Zonal Office	
		Sreepur Sub Zonal Office	
8	Complain Center	Baghabari Complain Centre	18
9		Baghutia Complain Centre	
10		Chara Battola Complain Center	
11		Dhulauri Complain Centre	
12		Dulai Complain Centre	
13		Jalalpur Complain Centre	
14		Kalyanpur Complain Centre	
15		Koitola Complain Centre	
16		Komorpur Complain Centre	
17		Madhpur Complain Centre	
18		Manikhat Complain Centre	
19		Nazirganj Complain Centre	
20		Satbaria Complain Center	

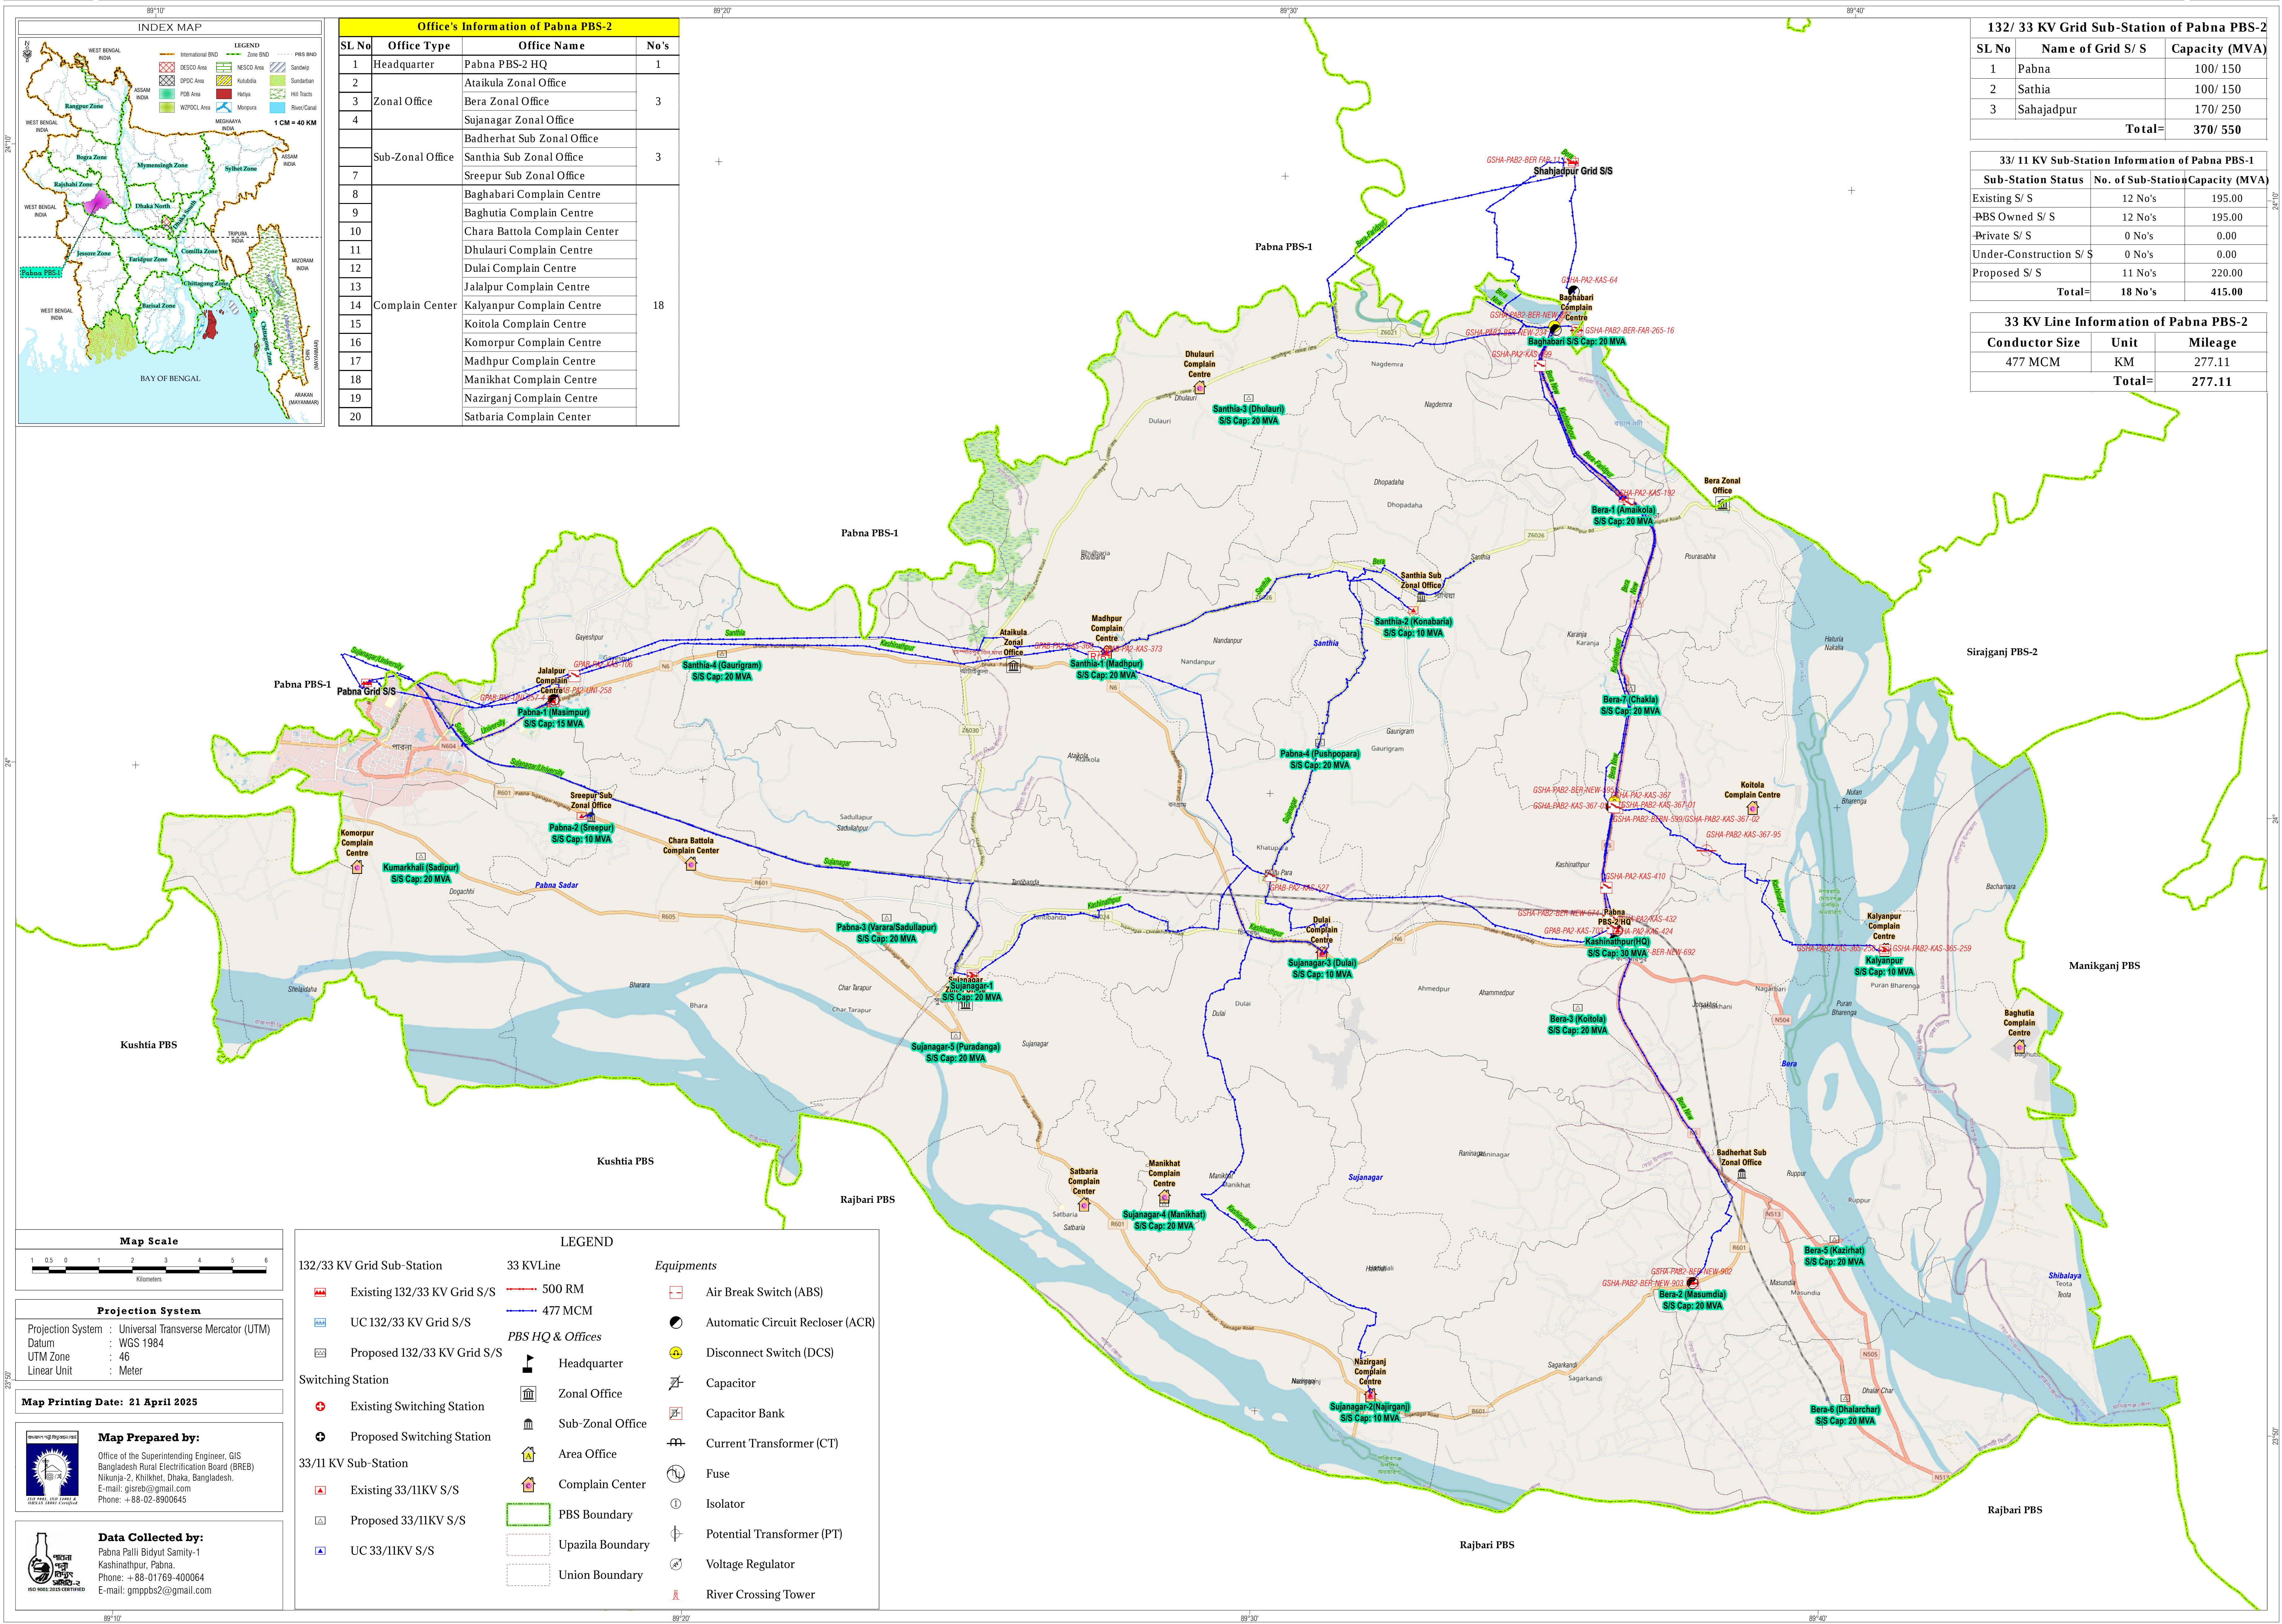

132/ 33 KV Grid Sub-Station of Pabna PBS-2		
SL No	Name of Grid S/ S	Capacity (MVA)
1	Pabna	100/ 150
2	Santhia	100/ 150
3	Sahajadpur	170/ 250
Total=		370/ 550

33/ 11 KV Sub-Station Information of Pabna PBS-1		
Sub-Station Status	No. of Sub-Station	Capacity (MVA)
Existing S/ S	12 No's	195.00
PBS Owned S/ S	12 No's	195.00
Private S/ S	0 No's	0.00
Under-Construction S/ S	0 No's	0.00
Proposed S/ S	11 No's	220.00
Total=		415.00

33 KV Line Information of Pabna PBS-2		
Conductor Size	Unit	Mileage
477 MCM	KM	277.11
Total=		277.11

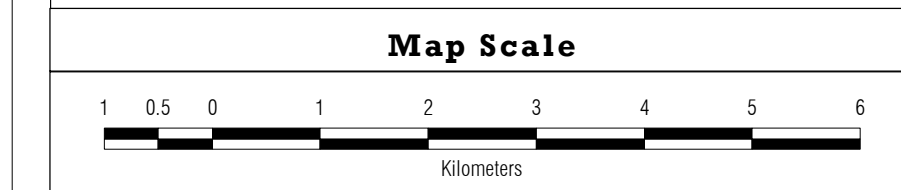

Projection System
Projection System : Universal Transverse Mercator (UTM)
Datum : WGS 1984
UTM Zone : 46
Linear Unit : Meter

Map Printing Date: 21 April 2025

Map Prepared by:
Office of the Superintending Engineer, GIS
Bangladesh Rural Electrification Board (BREB)
Nikunja-2, Khilkhet, Dhaka, Bangladesh.
E-mail: gisreb@gmail.com
Phone: +88-02-8900645

Data Collected by:
Pabna Palli Bidyut Samity-1
Kashinathpur, Pabna.
Phone: +88-01769-400064
E-mail: gmpbs2@gmail.com

LEGEND	
Existing 132/33 KV Grid S/S	500 RM
UC 132/33 KV Grid S/S	477 MCM
Proposed 132/33 KV Grid S/S	PBS HQ & Offices
Existing Switching Station	Headquarter
Proposed Switching Station	Zonal Office
Existing 33/11KV S/S	Sub-Zonal Office
Proposed 33/11KV S/S	Area Office
UC 33/11KV S/S	Complain Center
	PBS Boundary
	Upazila Boundary
	Union Boundary
Air Break Switch (ABS)	
Automatic Circuit Recloser (ACR)	
Disconnect Switch (DCS)	
Capacitor	
Capacitor Bank	
Current Transformer (CT)	
Fuse	
Isolator	
Potential Transformer (PT)	
Voltage Regulator	
River Crossing Tower	